


CARROLL COUNTY WATER AUTHORITY

FIG. 2  
OCT. 2015

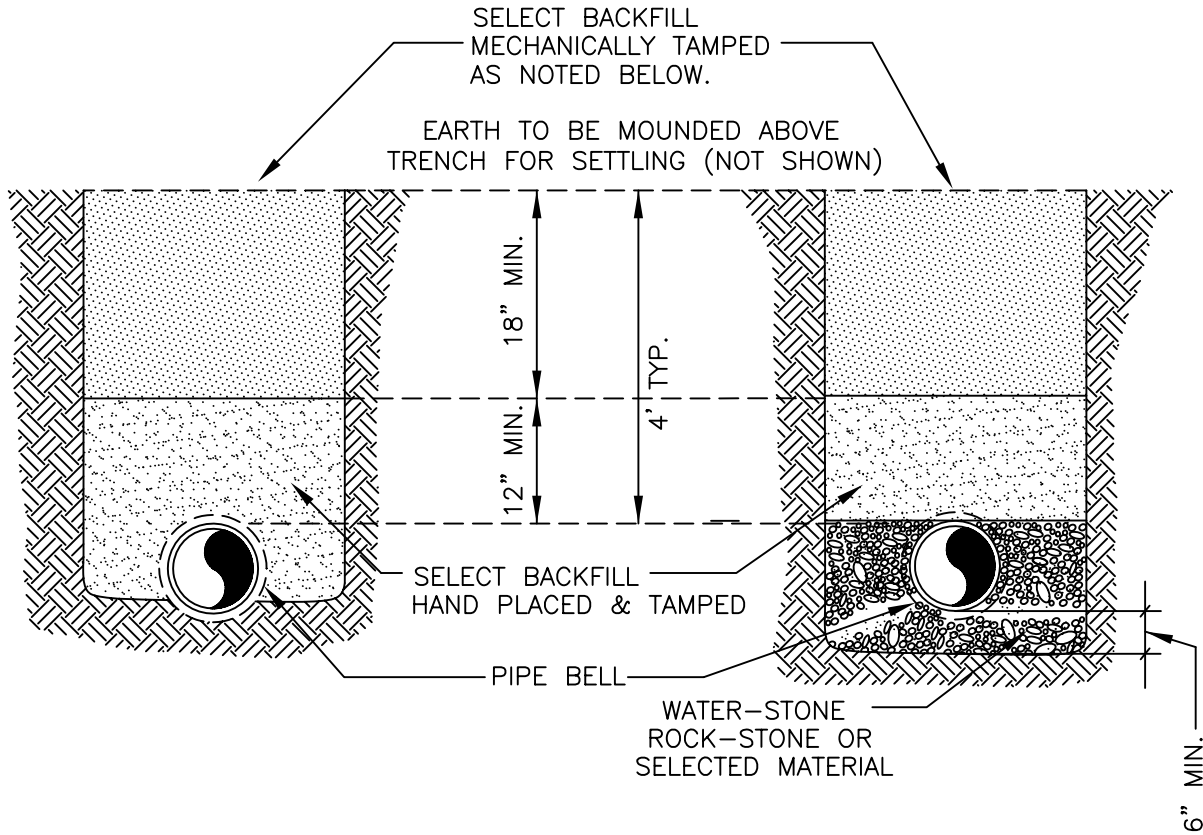

STANDARD EARTH

C-1

WET TRENCH OR ROCK

C-2

- NOTES: 1. TRACER WIRE REQUIRED FOR ALL WATERLINE INSTALLATIONS  
2. PIPE SHALL NOT BE LAID OR JOINED IN WATER.  
3. 95% STANDARD PROCTOR MAXIMUM DRY DENSITY REQUIRED BENEATH PAVEMENT.  
4. 100% STANDARD PROCTOR MAXIMUM DRY DENSITY REQUIRED WITHIN 10 FEET OF STRUCTURES AND PROPOSED BUILDING LINES.  
5. 90% STANDARD PROCTOR MAXIMUM DRY DENSITY REQUIRED IN OTHER AREAS.

**BEDDING DETAILS**