


CARROLL COUNTY WATER AUTHORITY

FIG. 16
JUNE 2016

NOTES:

1. ALUMINUM ACCESS DOOR FRAME AND COVER SHALL BE INTEGRALLY CAST IN CONCRETE VAULT TOP. PROVIDE DOOR WITH HANDLE AND MANUAL LOCKING ARM DEVICE, CAPABLE OF BEING SECURED WITH A PAD LOCK. PROVIDE ALUMINUM COVER SUITABLE FOR A MIN. 150 PSF LIVE LOAD.
2. ACCESS DOOR SHALL BE CENTERED OVER VALVE. HATCH SIZE SHALL BE 3' X 3' FOR VALVES SIZED 3" AND SMALLER AND 3' X 6' OR 4' X 6' FOR LARGER VALVES.
3. ALL CONNECTIONS SHALL BE FLANGED.
4. VALVE SHALL BE INSTALLED LEVEL.
5. CONCRETE CAP BLOCK(S) REQUIRED FROM UNDISTURBED EARTH TO VALVE BOTTOM AT CCWA ENGINEER'S DISCRETION (NOT SHOWN).
6. PROVIDE DRAIN PIPE CONNECTED TO FLOOR DRAIN SIZED TO MATCH WATER MAIN (3" MINIMUM) OR AS REQUIRED BY CCWA. PIPE MUST MAINTAIN A MINIMUM OF 1% SLOPE AND DAYLIGHT TO FINISHED GRADE OR INTO STORM SEWER.
7. VAULT SHALL BE COVERED WITH A REMOVABLE PRECAST CONCRETE COVER. THE COVER SHALL BE 6" THICK WITH STEEL REINFORCEMENT. COVER SHALL BE SEALED TO TOP OF WALLS USING GASKET MATERIAL.
8. PROVIDE MIN. 18" GRAVEL BASE, #57 STONE BENEATH SOLID CONCRETE VAULT BOTTOM.
9. PROVIDE NON-CORROSIVE PIPE SUPPORTS AS NEEDED TO PREVENT STRESS ON PIPING SYSTEM AND COMPONENTS IN VAULT.
10. TOP OF VAULT SHALL EXTEND 3" ABOVE FINISH GRADE. PROVIDE DRAINAGE AWAY FROM VAULT IN ALL DIRECTIONS.
11. SEAL ANNULUS BETWEEN PIPE AND WALL OPENING WITH HYDRAULIC CEMENT PRIOR TO BACKFILLING. ENSURE NO CONTACT BETWEEN PIPE AND VAULT WALL.
12. SEAL LIFTING HOLES TO FULL DEPTH WITH NON-SHRINK GROUT.
13. SEAL LID WITH WATERPROOF EXPANSION SEALL ALL AROUND, MASTIC TYPICAL.

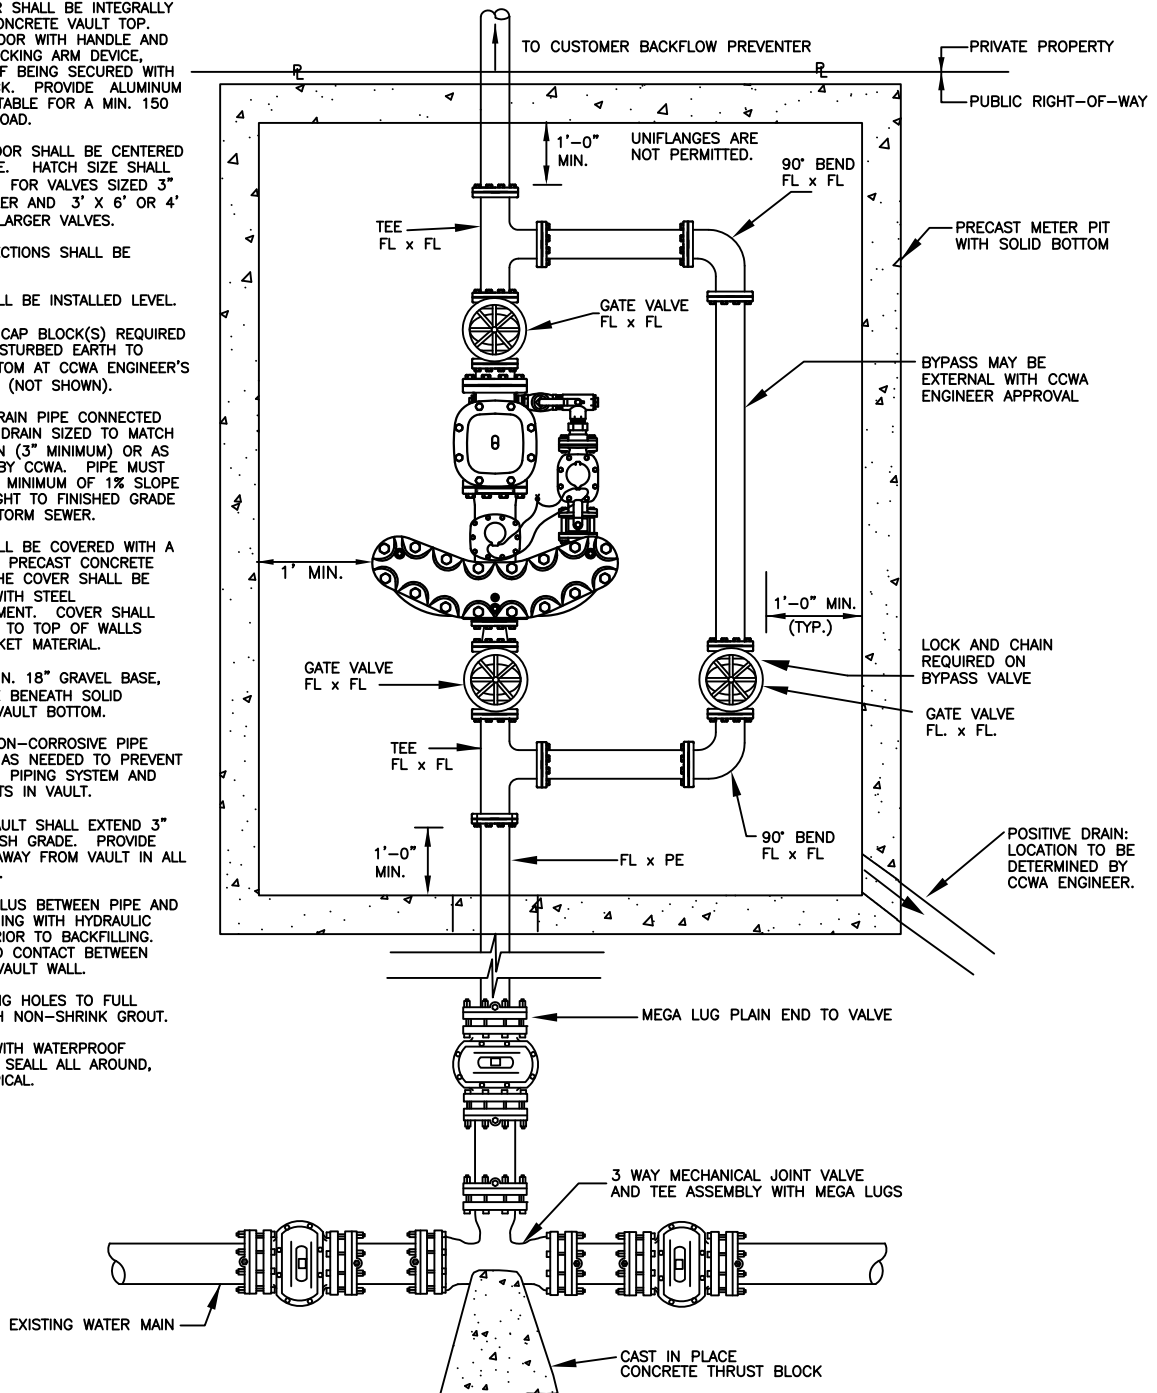

3" THRU 10" METER INSTALLATION DETAIL