


CARROLL COUNTY WATER AUTHORITY

FIG. 24
JAN 2022

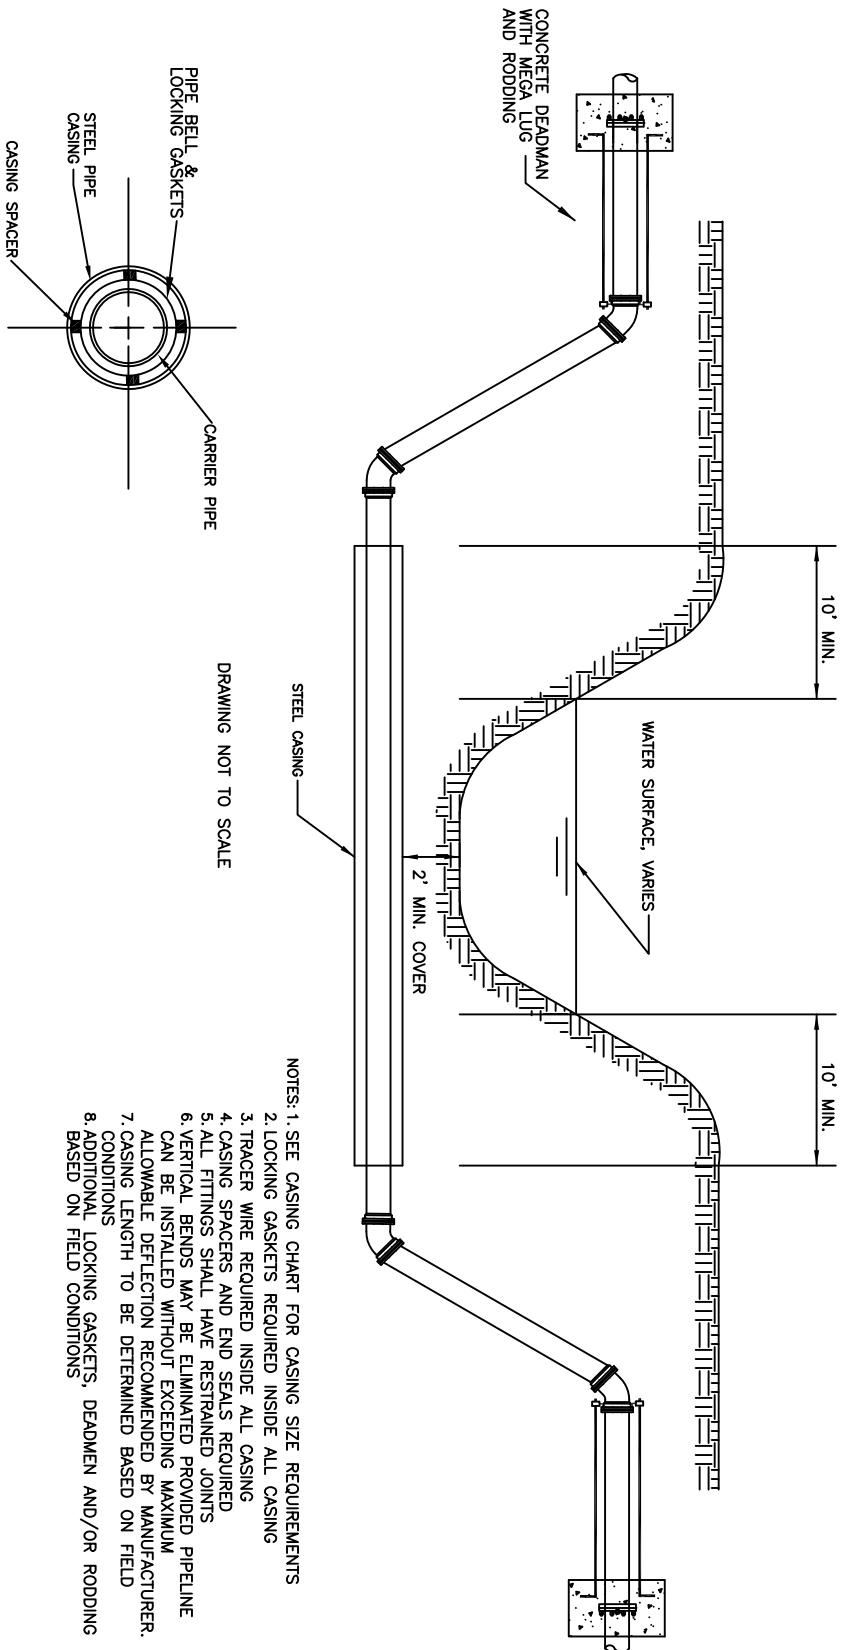

DRAWING NOT TO SCALE

- NOTES: 1. SEE CASING CHART FOR CASING SIZE REQUIREMENTS
 2. LOCKING GASKETS REQUIRED INSIDE ALL CASING
 3. TRACER WIRE REQUIRED INSIDE ALL CASING
 4. CASING SPACERS AND END SEALS REQUIRED
 5. ALL FITTINGS SHALL HAVE RESTRAINED JOINTS
 6. VERTICAL BENDS MAY BE ELIMINATED PROVIDED PIPELINE CAN BE INSTALLED WITHOUT EXCEEDING MAXIMUM ALLOWABLE DEFLECTION RECOMMENDED BY MANUFACTURER.
 7. CASING LENGTH TO BE DETERMINED BASED ON FIELD CONDITIONS
 8. ADDITIONAL LOCKING GASKETS, DEADMEN AND/OR RODDING BASED ON FIELD CONDITIONS

TRENCHED CREEK CROSSING