



A Bureau Veritas Group Company

LEVEL II ENERGY AUDIT

SACRAMENTO CITY UNIFIED SCHOOL DISTRICT

5735 47th Avenue
Sacramento, California 95824

DLR GROUP

1050 20th Street, Suite 250
Sacramento, California 95976



PREPARED BY:

EMG / A Bureau Veritas Company
10461 Mill Run Circle, Suite 1100
Owings Mills, Maryland 21117
800.733.0660
www.emgcorp.com

EMG CONTACT:

Kaustubh Anil Chabukswar
Program Manager
800.733.0660 x7512
kachabukswar@emgcorp.com

EMG PROJECT #:

136988.19R000-076.268

DATE OF REPORT:

October 30, 2019

ONSITE DATE:

October 8-9, 2019

ZERO NET ENERGY ASHRAE LEVEL II AUDIT

JOHN STILL MIDDLE (EAST CAMPUS)

2250 John Still Drive
Sacramento, California 95832



engineering | environmental | capital planning | project management

A Bureau Veritas Group Company



TABLE OF CONTENTS

Certification 1

1. Executive Summary 2

 1.1. Energy Conservation Measures 2

2. Introduction 7

3. Facility Overview and Existing Conditions 8

 3.1. Building Occupancy and Point of Contact 8

 3.2. Building Heating, Ventilating and Air-Conditioning (HVAC) 8

 3.3. Lighting 9

4. Utility Analysis 10

 4.1. Electricity 11

 4.2. Natural Gas 13

 4.3. Water and Sewer 15

5. Renewable Energy Discussions 17

 5.1. Rooftop Solar Photovoltaic Feasibility 17

6. Operations and Maintenance Plan 19

7. Appendices 21

 Appendix A: Glossary of Terms

 Appendix B: Mechanical Equipment Inventory

 Appendix C: Lighting System Schedule

 Appendix D: ECM Checklist

 Appendix E: ECM Calculations

 Appendix F: Solar Pv

Certification

EMG has completed an Energy Audit of John Still Middle School located at 2250 John Still Drive in Sacramento, California. EMG visited the site on October 8-9, 2019

The assessment was performed at the Client's request using methods and procedures consistent with ASHRAE Level II Energy Audit and using methods and procedures as outlined in EMG's Proposal.

This report has been prepared for and is exclusively for the use and benefit of the Client identified on the cover page of this report. The purpose for which this report shall be used shall be limited to the use as stated in the contract between the client and EMG.

This report, or any of the information contained therein, is not for the use or benefit of, nor may it be relied upon by any other person or entity, for any purpose without the advance written consent of EMG. Any reuse or distribution without such consent shall be at the client's or recipient's sole risk, without liability to EMG.

Estimated installation costs are based on EMG's experience on similar projects and industry standard cost estimating tools including *RS Means and Whitestone CostLab*. In developing the installed costs, EMG also considered the area correction factors for labor rates for Sacramento, CA. Since actual installed costs may vary widely for particular installation based on labor & material rates at time of installation, EMG does not guarantee installed cost estimates and shall in no event be liable should actual installed costs vary from the estimated costs herein. We strongly encourage the owner to confirm these cost estimates independently. EMG does not guarantee the costs savings estimated in this report. EMG shall in no event be liable should the actual energy savings vary from the savings estimated herein.

EMG certifies that EMG has no undisclosed interest in the subject property and that EMG's employment and compensation are not contingent upon the findings or estimated costs to remedy any deficiencies due to deferred maintenance and any noted component or system replacements.

Any questions regarding this report should be directed to Kaustubh Anil Chabukswar at 800.733.0660, ext. 7512.

Prepared by: Beth A. Stauffer
Project Team



Reviewed by:

Bhaskar Ale, CEM
Technical Report Reviewer for
Kaustubh Anil Chabukswar, CEM CRM
Program Manager

1. Executive Summary

The purpose of this Energy Audit is to provide Sacramento City Unified School District and John Still Middle School with a baseline of energy usage and the relative energy efficiency of the facility and specific recommendations for Energy Conservation Measures. Information obtained from these analyses may be used to support a future application to an Energy Conservation Program, Federal & Utility grants towards energy conservation, support performance contracting, justify a municipal bond funded improvement program, or as a basis for replacement of equipment or systems.

| Bldg # | Structures Assessed | Building Type | EMG Calculated Area (SF) | Estimated Occupancy |
|--------|---------------------|-----------------|--------------------------|---------------------|
| 1 | 00A | School Building | 10,815 | 65 – 75 |
| 2 | 00B | School Building | 24,257 | 145 – 165 |
| 3 | 00C | School Building | 7,803 | 45 – 55 |
| 4 | 00D | School Building | 19,685 | 115 – 135 |
| 5 | 00E | School Building | 12,850 | 75 – 90 |
| 6 | 00F | School Building | 13,586 | 80 – 95 |
| 7 | 00G | School Building | 5,736 | 30 - 40 |

The study included a review of the building's construction features, historical energy and water consumption and costs, review of the building envelope, HVAC equipment, heat distribution systems, lighting, and the building's operational and maintenance practices.

1.1. Energy Conservation Measures

EMG has identified four Energy Conservation Measures (ECMs) for this property. The savings for each measure is calculated using standard engineering methods followed in the industry, and detailed calculations for ECM are provided in Appendix for reference. A 10% discount in energy savings was applied to account for the interactive effects amongst the ECMs. In addition to the consideration of the interactive effects, EMG has applied a 15% contingency to the implementation costs to account for potential cost overruns during the implementation of the ECMs.

The following table summarizes the recommended ECMs in terms of description, investment cost, energy consumption reduction, and cost savings.

Summary of Financial Information for Recommended Non-Renewable Energy Conservation Measures

| ITEM | ESTIMATE |
|---|---|
| Net Initial ECM Investment (<i>Current Dollars Only</i>) | \$ 183,955 (<i>In Current Dollars</i>) |
| Estimated Annual Cost Savings (<i>Current Dollars Only</i>) | \$ 18,751 (<i>In Current Dollars</i>) |
| ECM Effective Payback | 9.81 years |
| Estimated Annual Energy Savings | 17.30 % |
| Estimated Annual Energy Utility Cost Savings (<i>Excluding Water</i>) | 17.91 % |
| Estimated Annual Water Cost Saving | 0.30 % |

Solar Photovoltaic (PV) Screening for John Still Middle School

| SOLAR ROOFTOP PHOTOVOLTAIC ANALYSIS | | |
|-------------------------------------|-----------|-------|
| Estimated Number of Panels | 578 | |
| Estimated KW Rating | 182 | KW |
| Potential Annual kWh Produced | 283,548 | kWh |
| % of Current Electricity Uses | 60.8% | |
| FINANCIAL SUMMARY | | |
| Investment Cost | \$637,350 | |
| Estimated Energy Cost Savings | \$45,368 | |
| Payback without Incentives | 14 | Years |
| Incentive Payback but without SRECs | 8.5 | Years |
| Payback with All Incentives | 8.5 | Years |

Key Metrics to Benchmark the Subject Property's Energy Usage Profile

- **Building Site Energy Use Intensity** - The sum of the total site energy use in thousands of Btu per unit of gross building area. Site energy accounts for all energy consumed at the building location only not the energy consumed during generation and transmission of the energy to the site.
- **Building Source Energy Use Intensity** – The sum of the total source energy use in thousands of Btu per unit of gross building area. Source energy is the energy consumed during generation and transmission in supplying the energy to your site.
- **Building Cost Intensity** - This metric is the sum of all energy use costs in dollars per unit of gross building area.
- **Greenhouse Gas Emissions** - Although there are numerous gases that are classified as contributors to the total for Greenhouse Emissions, the scope of this energy audit focuses on carbon dioxide (CO₂). Carbon dioxide enters the atmosphere through the burning of fossil fuels (oil, natural gas, and coal), solid waste, trees and wood products, and also as a result of other chemical reactions (e.g., manufacture of cement).

| SITE ENERGY USE INTENSITY (EUI) | RATING |
|--|-------------------------|
| Current Site Energy Use Intensity (EUI) | 27 kBtu/ft ² |
| Post ECM Site Energy Use Intensity (EUI) | 22 kBtu/ft ² |
| SOURCE ENERGY USE INTENSITY (EUI) | RATING |
| Current Source Energy Use Intensity (EUI) | 67 kBtu/ft ² |
| Post ECM Source Energy Use Intensity (EUI) | 55 kBtu/ft ² |
| BUILDING COST INTENSITY (BCI) | RATING |
| Current Building Cost Intensity | \$0.92/ft ² |
| Post ECM Building Cost Intensity | \$0.75/ft ² |

Summary of the Greenhouse Gas Reductions from Recommended Non-Renewable Energy Conservation Measures

The following table provides a summary of the projected Greenhouse Gas Emissions reductions as a result of the recommended Energy Conservation Measures:

| GREENHOUSE GAS EMISSIONS REDUCTION | |
|---|-----------------------------|
| Estimated Annual Thermal Energy Reduction | 439 MMbtu |
| Total CO ₂ Emissions Reduced | 35.84 MtCO ₂ /Yr |
| Total Cars Off the Road (Equivalent)* | 7 |
| Total Acres of Pine Trees Planted (Equivalent)* | 8 |

*Equivalent reductions per DOE emissions calculation algorithms

Zero Net Energy Analysis for Renewable and Non-Renewable Recommended Measures

| ZERO NET ENERGY ANALYSIS | |
|---|----------------|
| Building Annual Net Energy Consumption | 2,537,360 kBtu |
| Total Annual Energy Savings for Non-Renewable Energy Measures | 438,861 kBtu |
| Total Annual Energy Savings from Renewable Energy Measures | 967,466 kBtu |
| Total Annual Energy Savings | 1,406,327 kBtu |
| Net Energy Consumption from Grid Post Implementation | 1,131,034 kBtu |
| % Energy Reduction (Annual Energy-Net Energy) / (Annual Energy) | 55% |

Energy Conservation Measures Screening:

EMG screens ECMs using two financial methodologies. ECMs which are considered financially viable must meet both criteria.

1. **Simple Payback Period** –The number of years required for the cumulative value of energy or water cost savings less future non-fuel or non-water costs to equal the investment costs of the building energy or water system, without consideration of discount rates. ECMs with a payback period greater than the Expected Useful Life (EUL) of the project are not typically recommended, as the cost of the project will not be recovered during the lifespan of the equipment. These ECMs are recommended for implementation during future system replacement. At that time, replacement may be evaluated based on the premium cost of installing energy efficient equipment.

$$\text{Simple Payback} = \frac{\text{Initial Cost}}{\text{Annual Savings}}$$

2. **Savings-to-Investment Ratio (SIR)** – The savings-to-investment ratio is the ratio of the present value savings to the present value costs of an energy or water conservation measure. The numerator of the ratio is the present value over the estimated useful life (EUL) of net savings in energy or water and non-fuel or non-water operation and maintenance costs attributable to the proposed energy or water conservation measure. The denominator of the ratio is the present value of the net increase in investment and replacement costs less salvage value attributable to the proposed energy or water conservation measure. It is recommended that energy efficiency recommendations should be based on a calculated SIR, with larger SIRs receiving a higher priority. A project is typically only recommended if SIR is greater than or equal to 1.0, unless other factors outweigh the financial benefit.

$$\text{SIR} = \frac{\text{Present Value (Annual Savings, } i\%, \text{ EUL)}}{\text{Initial Cost}}$$

| List of Recommended Energy Conservation Measures For John Still Middle (East Campus) | | | | | | | | | | | | |
|--|--|------------------------------|---------------------------------|---------------|--------------------------------|------------------------|------------------------------|-------------------------------------|----------------|--------|--------------------|----------------------------|
| ECM # | Description of ECM | Projected Initial Investment | Estimated Annual Energy Savings | | Estimated Annual Water Savings | Estimated Cost Savings | Estimated Annual O&M Savings | Total Estimated Annual Cost Savings | Simple Payback | S.I.R. | Life Cycle Savings | Expected Useful Life (EUL) |
| | | | Natural Gas | Electricity | | | | | | | | |
| | | \$ | Therms | kWh | kgal | \$ | \$ | \$ | Years | | \$ | Years |
| No/Low Cost Recommendations | | | | | | | | | | | | |
| 1 | Install Low Flow Faucet Aerators | \$670 | 187 | 0 | 26 | \$378 | \$0 | \$378 | 1.77 | 4.81 | \$2,554 | 10.00 |
| | Location: John Still Middle School - All Buildings | | | | | | | | | | | |
| Totals for No/Low Cost Items | | \$670 | 187 | 0 | 26 | \$378 | \$0 | \$378 | 1.77 | | | |
| Capital Cost Recommendations | | | | | | | | | | | | |
| 1 | Install Timers On Exhaust Fans | \$1,416 | 365 | 5,014 | 0 | \$1,273 | \$0 | \$1,273 | 1.11 | 10.73 | \$13,780 | 15.00 |
| | Location: All Buildings | | | | | | | | | | | |
| 2 | Re-Commission The Building & Its Control Systems | \$42,418 | 1,095 | 13,800 | 0 | \$3,622 | \$0 | \$3,622 | 11.71 | 1.02 | \$820 | 15.00 |
| | Location: John Still Middle School - All Buildings | | | | | | | | | | | |
| 3 | Upgrade Building Lighting to LED and Install Automatic Lighting Controls | \$115,457 | 0 | 75,851 | 0 | \$12,119 | \$3,442 | \$15,562 | 7.42 | 1.61 | \$70,315 | 15.00 |
| | Location: Building Interior And Exterior | | | | | | | | | | | |
| Total For Capital Cost | | \$159,291 | 1,460 | 94,666 | 0 | \$17,014 | \$3,442 | \$20,456 | 7.79 | | | |
| | <i>Interactive Savings Discount @ 10%</i> | | -165 | -9,467 | -3 | -\$1,739 | -\$344 | -\$2,083 | | | | |
| | <i>Total Contingency Expenses @ 15%</i> | \$23,994 | | | | | | | | | | |
| Total for Improvements | | \$183,955 | 1,482 | 85,199 | 24 | \$15,653 | \$3,098 | \$18,751 | 9.81 | | | |



In addition to the above measures, EMG has identified the following measure(s) but has not recommended as they fail to meet the above-mentioned financial criteria of SIR>1.0. Thus, EMG has classified the measure(s) as recommended for consideration.

| List of Recommended For Consideration Energy Conservation Measures For John Still Middle (East Campus) | | | | | | | | | | | | |
|---|---|--------------------|-----------------------|---------------|----------------------|----------------|------------------------------|-------------------------------------|--------------|--------|--------------------|----------------------------|
| ECM # | Description of ECM | Initial Investment | Annual Energy Savings | | Annual Water Savings | Cost Savings | Estimated Annual O&M Savings | Total Estimated Annual Cost Savings | Payback | S.I.R. | Life Cycle Savings | Expected Useful Life (EUL) |
| | | | \$ | Natural Gas | | | | | | | | |
| 1 | Install Low Flow Tankless Restroom Fixtures | \$40,802 | 0 | 0 | 155 | \$800 | \$0 | \$800 | 50.98 | 0.23 | -\$31,247 | 15.00 |
| | Location: John Still Middle School - All Buildings | | | | | | | | | | | |
| 2 | Replace Existing Water Heater With New Energy Efficient Units | \$35,413 | 531 | 1,729 | 0 | \$963 | \$0 | \$963 | 36.78 | 0.37 | -\$22,172 | 18.00 |
| | Location: John Still Middle School | | | | | | | | | | | |
| 3 | Replace Inefficient Furnace and Air Conditioning System | \$184,195 | 330 | 10,614 | 0 | \$2,123 | \$106 | \$2,229 | 82.63 | 0.18 | -\$151,033 | 20.00 |
| | Location: John Still Middle - All Buildings Furnaces And Condensers | | | | | | | | | | | |
| Total for Improvements | | \$260,411 | 861 | 12,343 | 155 | \$3,886 | \$106 | \$3,992 | 65.23 | | | |



2. Introduction

The purpose of this Energy Audit is to provide John Still Middle School and Sacramento City Unified School District with a baseline of energy usage, the relative energy efficiency of the facility, and specific recommendations for Energy Conservation Measures. Information obtained from these analyses may be used to support a future application to an Energy Conservation Program, Federal and Utility grants towards energy conservation, as well as support performance contracting, justify a municipal bond-funded improvement program, or as a basis for replacement of equipment or systems.

The energy audit consisted of an onsite visual assessment to determine current conditions, itemize the energy consuming equipment (i.e. Boilers, Make-Up Air Units, DWH equipment); review lighting systems both exterior and interior; and review efficiency of all such equipment. The study also included interviews and consultation with operational and maintenance personnel. The following is a summary of the tasks and reporting that make up the Energy Audit portion of the report.

The following is a summary of the tasks and reporting that make up the Energy Audit portion of the report.

ENERGY AND WATER USING EQUIPMENT

- EMG has surveyed the common areas, office areas, rooms, maintenance facilities and mechanical rooms to document utility-related equipment, including heating systems, cooling systems, air handling systems and lighting systems.

BUILDING ENVELOPE

- EMG has reviewed the characteristics and conditions of the building envelope, checking insulation values and conditions. This review also includes an inspection of the condition of walls, windows, doors, roof areas, insulation and special use areas

RECOMMENDATIONS FOR ENERGY SAVINGS OPPORTUNITIES

- Based on the information gathered during the on-site assessment, the utility rates, as well as recent consumption data and engineering analysis, EMG has identified opportunities to save energy and provide probable construction costs, projected energy/utility savings and provide a simple payback analysis.

ANALYSIS OF ENERGY CONSUMPTION

- Based on the information gathered during the on-site assessment, EMG has conducted an analysis of the energy usage of all equipment, and identified which equipment is using the most energy and what equipment upgrades may be necessary. As a result, equipment upgrades, or replacements are identified that may provide a reasonable return on the investment and improve maintenance reliability.

ENERGY AUDIT PROCESS

- Interviewing staff and review plans and past upgrades
- Performing an energy audit for each use type
- Performing a preliminary evaluation of the utility system
- Analyzing findings, utilizing ECM cost-benefit worksheets
- Making preliminary recommendations for system energy improvements and measures
- Estimating initial cost and changes in operating and maintenance costs based on implementation of energy efficiency measures
- Ranking recommended cost measures, based on the criticality of the project and the largest payback

REPORTING

The EMG Energy Audit Report includes:

- A comprehensive study identifying all applicable Energy Conservation Measures (ECMs) and priorities, based on initial cost and payback
- A narrative discussion of building systems/components considered and a discussion of energy improvement options;
- A summary of ECMs including initial costs and simple paybacks, based on current utility rates and expected annual savings.

3. Facility Overview and Existing Conditions

3.1. Building Occupancy and Point of Contact

| FACILITY SCHEDULE | |
|------------------------------|-----|
| Hours of Operations / Week | 40 |
| Operational Weeks / Year | 37 |
| Estimated Facility Occupancy | 618 |
| % of Male Occupants | 50 |

| POINT OF CONTACT | |
|-----------------------------------|---------------|
| Point of Contact Name | Frank Carrera |
| Point of Contact Title | Plant Manager |
| Point of Contact – Contact Number | 916.538.8975 |

3.2. Building Heating, Ventilating and Air-Conditioning (HVAC)

Description:

Heating and cooling are mainly provided by rooftop packaged units or split systems with high efficiency gas furnaces. There is a hydronic system with a central boiler utilized at two of the buildings. Supplementary ductless split system are also located at Building 00F.

The Mechanical Equipment Schedule in the Appendices contains a summary of the HVAC Equipment at the property.

| BUILDING CENTRAL HEATING SYSTEM | |
|------------------------------------|---------------------------------|
| Primary Heating System | Rooftop Packaged Units, Furnace |
| Secondary Heating System | Boiler |
| Hydronic Distribution System | Two Pipe |
| Primary Heating Fuel | Natural Gas |
| Heating Mode Set-point | 69 °F |
| Heating Mode- Set-back Temperature | 53 °F |

| BUILDING COOLING SYSTEM | |
|------------------------------------|-----------------------------|
| Primary Cooling System | Package Units, Split system |
| Secondary Cooling System | Ductless Split System |
| Hydronic Distribution System | NA |
| Cooling Mode Set-point | 73 °F |
| Cooling Mode- Set-back Temperature | 93 °F |

| AIR DISTRIBUTION SYSTEM | |
|---|--|
| Building Ventilation | Air handlers and Roof Top Exhaust Fans |
| On-Demand Ventilation System in Use? | No |
| Energy Recovery Wheel / Enthalpy Wheel Exhaust Fans | No |

| DOMESTIC HOT WATER SYSTEM | |
|-----------------------------|--------------------------|
| Primary Domestic Water Fuel | Electric and Natural Gas |

3.3. Lighting

Description:

The lighting in the school building primarily consists of T5 linear fluorescent lamp fixtures in classrooms and hallways. The fixtures were observed to be operating on bi-level mode in the classrooms. The exterior lights were primarily High Intensity Discharge (HID) fixtures.

The detailed lighting schedule and the proposed LED alternative is provided in Appendix.

4. Utility Analysis

Establishing the energy baseline begins with an analysis of the utility cost and consumption of the building. Utilizing the historical energy data and local weather information, we evaluate the existing utility consumption and assign it to the various end-uses throughout the buildings. The Historical Data Analysis breaks down utilities by consumption, cost and annual profile.

This data is analyzed, using standard engineering assumptions and practices. The analysis serves the following functions:

- Allows our engineers to benchmark the energy and water consumption of the facilities against consumption of efficient buildings of similar construction, use and occupancy.
- Generates the historical and current unit costs for energy and water
- Provides an indication of how well changes in energy consumption correlate to changes in weather.
- Reveals potential opportunities for energy consumption and/or cost reduction. For example, the analysis may indicate that there is excessive, simultaneous heating and cooling, which may mean that there is an opportunity to improve the control of the heating and cooling systems.

By performing this analysis and leveraging our experience, our engineers prioritize buildings and pinpoint systems for additional investigation during the site visit, thereby maximizing the benefit of their time spent on-site and minimizing time and effort by the customer's personnel.

Based upon the utility information provided about the Sacramento City Unified School District, the following energy rates are utilized in determining existing and proposed energy costs.

Utility Rates used for Cost Analysis

| ELECTRICITY (BLENDED RATE) | NATURAL GAS | WATER / SEWER |
|-------------------------------|---------------|---------------|
| \$0.16 /kWh | \$1.29 /therm | \$5.18 /kGal |

The data analyzed provides the following information: 1) breakdown of utilities by consumption, 2) cost and annual profile, 3) baseline consumption in terms of energy/utility at the facility, 4) the Energy Use Index, or Btu/sq ft, and cost/sq ft. For multiple water meters, the utility data is combined to illustrate annual consumption for each utility type.



4.1. Electricity

SMUD satisfies the electricity requirements for the facility. The primary end uses for electric utility comprises of lighting, cooling, office/school equipment, and appliances in the break room.

The table below provides the electric use for the period of twelve continuous months.

Electric Consumption and Cost Data

| Billing Month | Electricity Consumption (kWh) | Unit Cost/kWh | Total Cost |
|---------------|-------------------------------|---------------|-----------------|
| July,18 | 39,971 | \$0.17 | \$6,956 |
| August,18 | 32,959 | \$0.20 | \$6,441 |
| September,18 | 42,562 | \$0.15 | \$6,507 |
| October,18 | 45,313 | \$0.15 | \$6,845 |
| November,18 | 37,990 | \$0.15 | \$5,796 |
| December,18 | 35,547 | \$0.16 | \$5,539 |
| January,19 | 35,898 | \$0.16 | \$5,631 |
| February,19 | 36,147 | \$0.15 | \$5,472 |
| March,19 | 40,065 | \$0.16 | \$6,267 |
| April,19 | 35,975 | \$0.16 | \$5,725 |
| May,19 | 43,689 | \$0.15 | \$6,706 |
| June,19 | 39,991 | \$0.16 | \$6,588 |
| Total | 466,108 | \$0.16 | \$74,474 |

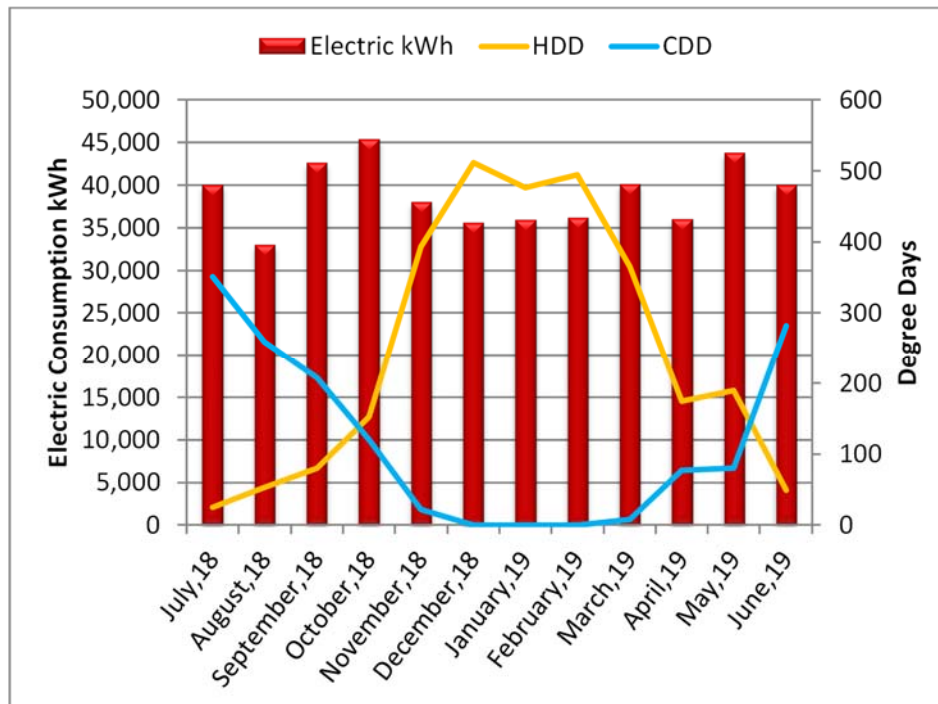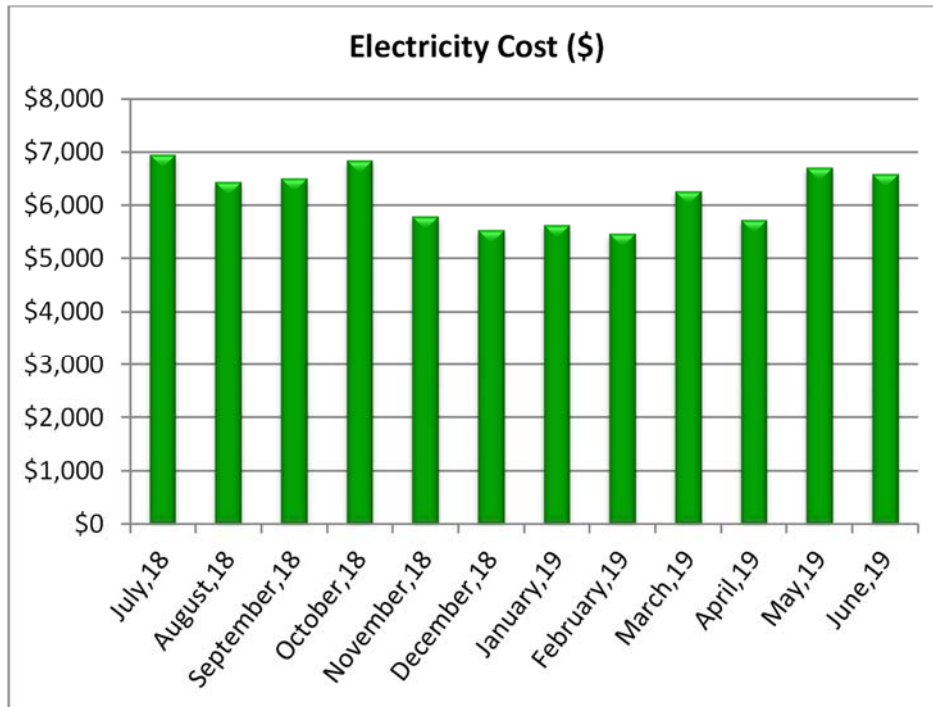



4.2. Natural Gas

PGE satisfies the natural gas requirements of the facility. The primary end use of natural gas is for building heating, domestic water heating, and cooking in the cafeteria.

The analysis of the 12 months of consumption is provided below.

Natural Gas Consumption and Cost Data

| Billing Month | Natural gas Consumption (Therms) | Unit Cost/therm | Total Cost |
|---------------|----------------------------------|-----------------|-----------------|
| July,18 | 135 | \$1.42 | \$193 |
| August,18 | 124 | \$1.46 | \$181 |
| September,18 | 144 | \$1.34 | \$194 |
| October,18 | 191 | \$1.28 | \$245 |
| November,18 | 711 | \$1.24 | \$879 |
| December,18 | 1,164 | \$1.36 | \$1,584 |
| January,19 | 2,114 | \$1.29 | \$2,718 |
| February,19 | 2,227 | \$1.30 | \$2,892 |
| March,19 | 1,708 | \$1.30 | \$2,222 |
| April,19 | 490 | \$1.22 | \$596 |
| May,19 | 408 | \$1.20 | \$488 |
| June,19 | 53 | \$1.21 | \$64 |
| Total | 9,470 | \$1.29 | \$12,255 |

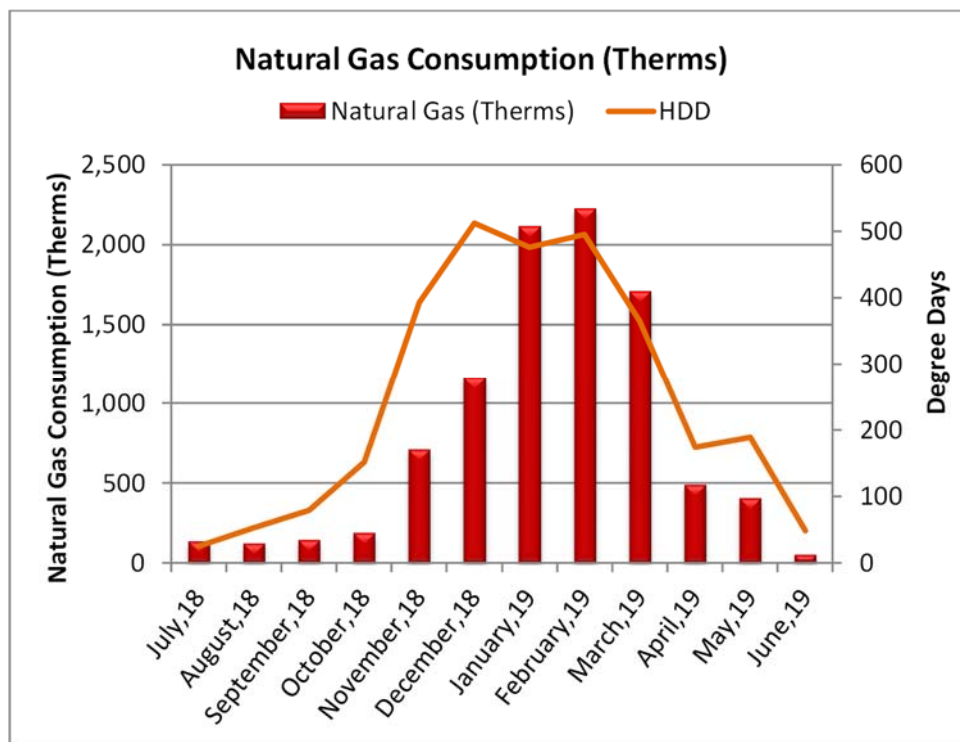
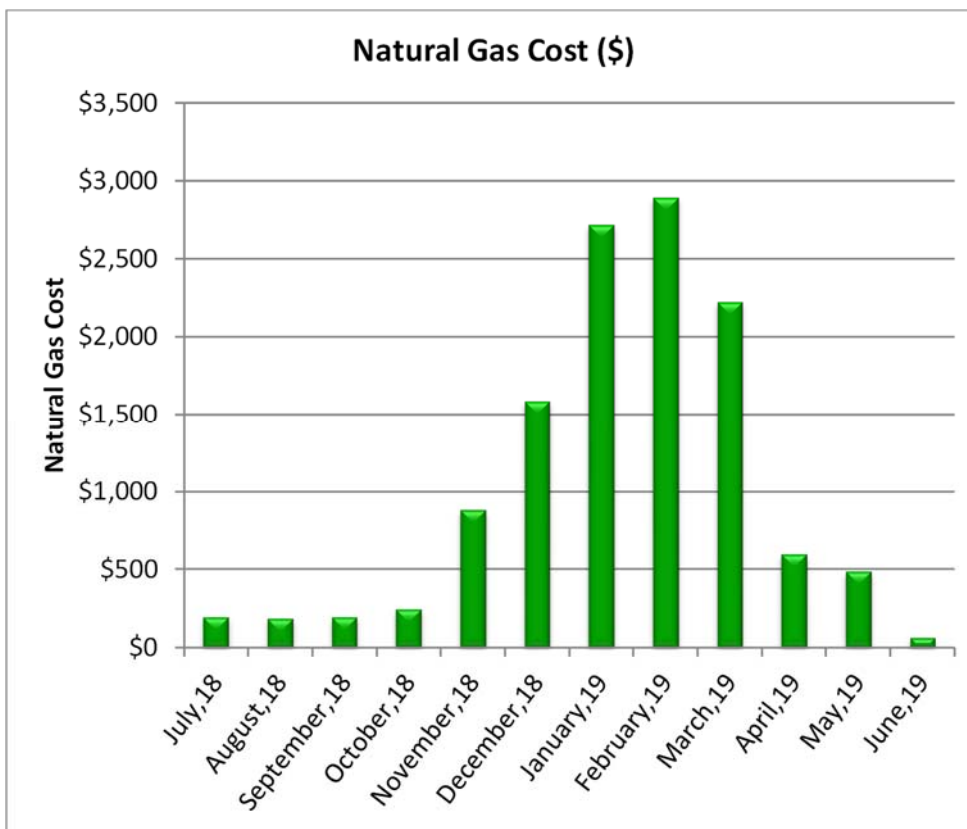


4.3. Water and Sewer

The City of Sacramento satisfies the water requirements for the facility. The primary end use of water is the plumbing fixtures such as staff showers, water closets, and lavatories. The table below provides the twelve continuous months' worth of consumption and cost for water in kGal for the facility.

Water and Sewer Consumption and Cost Data

| Billing Month | Consumption (kGal) | Unit Cost (\$/kGal) | Total Cost |
|---------------|--------------------|---------------------|-----------------|
| July,18 | 1,859 | \$3.93 | \$7,304 |
| August,18 | 1,981 | \$3.87 | \$7,671 |
| September,18 | 1,728 | \$3.95 | \$6,830 |
| October,18 | 1,179 | \$4.28 | \$5,046 |
| November,18 | 733 | \$4.78 | \$3,501 |
| December,18 | 248 | \$9.18 | \$2,279 |
| January,19 | 49 | \$35.69 | \$1,750 |
| February,19 | 42 | \$36.17 | \$1,530 |
| March,19 | 45 | \$40.25 | \$1,807 |
| April,19 | 42 | \$41.15 | \$1,730 |
| May,19 | 13 | \$49.87 | \$625 |
| June,19 | 24 | \$42.37 | \$1,032 |
| Total | 7,943 | \$5.18 | \$41,105 |

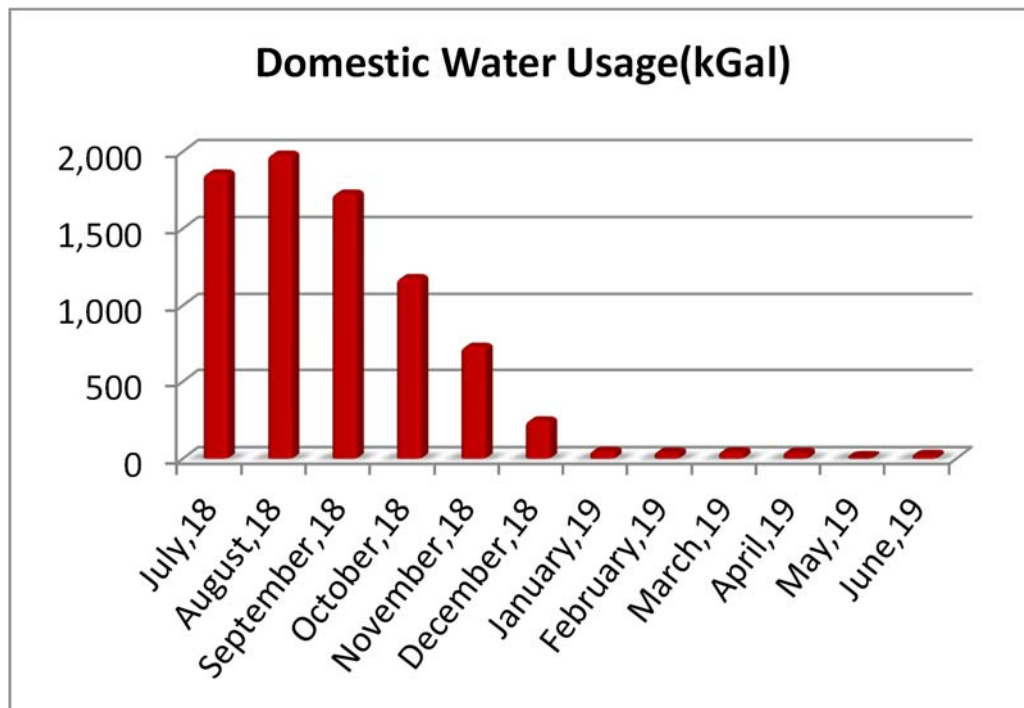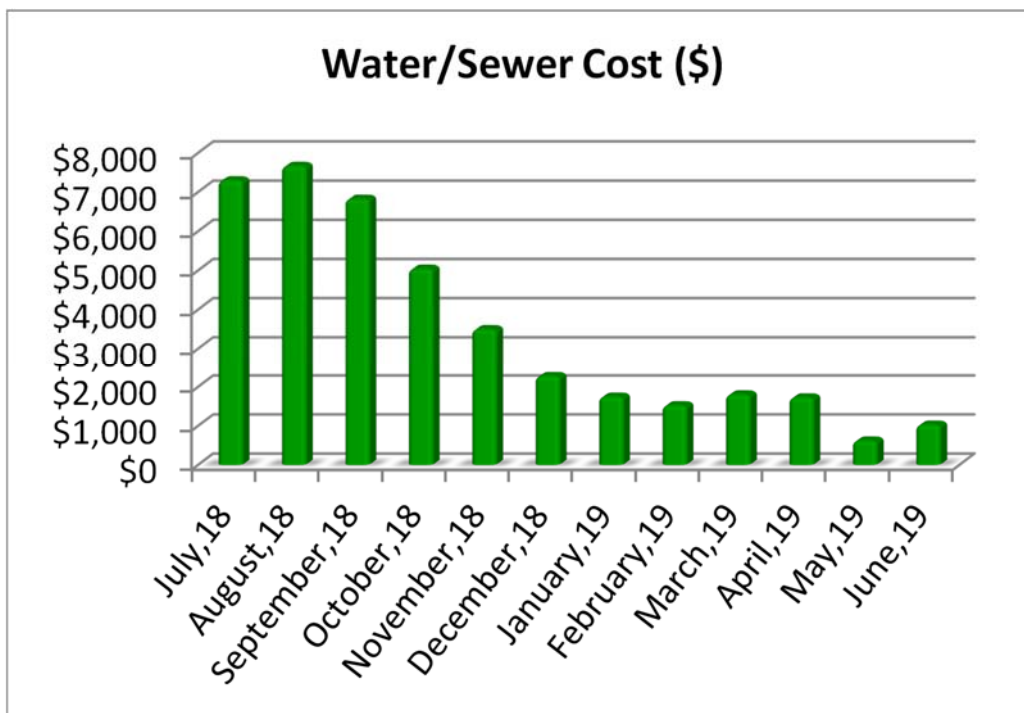

5. Renewable Energy Discussions

5.1. Rooftop Solar Photovoltaic Feasibility

Solar Energy Feasibility

A photovoltaic array is a linked collection of photovoltaic modules, which are in turn made of multiple interconnected solar cells. The cells convert solar energy into direct current electricity via the photovoltaic effect. The power that one module can produce is seldom enough to meet requirements of a home or a business, so the modules are linked together to form an array. Most PV arrays use an inverter to convert the DC power produced by the modules into alternating current that can plug into the existing infrastructure to power lights, motors, and other loads. The modules in a PV array are usually first connected in series to obtain the desired voltage; the individual strings are then connected in parallel to allow the system to produce more current. Solar arrays are typically measured by the peak electrical power they produce, in watts, kilowatts, or even megawatts.

When determining if a site is suitable for a solar application, two basic considerations must be evaluated:

- At minimum, the sun should shine upon the solar collectors from 9 AM to 3 PM. If less, the application may still be worthwhile, but the benefit will be less.
- The array should face south and be free of any shading from buildings, trees, rooftop equipment, etc. If the array is not facing directly south, there will be a penalty in transfer efficiency, reducing the overall efficiency of the system.

| SOLAR PV QUESTIONNAIRE | RESPONSE |
|--|----------------------------------|
| Does the property have a south, east, or west facing roof or available land of more than 250 square feet per required Solar Array Panel? | Yes |
| Is the area free from any shading such as trees, buildings, equipment etc throughout the whole day? | Yes |
| Can the panels be mounted at an incline of roughly 25-45 degrees? (equal to latitude of property) | Yes |
| Is the property in an area with acceptable average monthly sunlight levels? | Yes |
| Has the roofing been replaced within the past 3-5 years? | No |
| Is the roof structure sufficient to hold solar panels? | Additional Study Required |
| Is the property located in a state eligible for net metering? | Yes |

A solar feasibility analysis of the John Still Middle School site has resulted in the building containing more than sufficient amount of roof area for solar electricity generation. The analysis through the use of National Renewable Energy Laboratory's solar photovoltaic software assisted in calculating the potential electricity generated from the allocated land and roof area set for solar photovoltaic installment. The allocated roof area was through looking at the roof and surrounding areas at a bird's eye view. Also detailed in the report are incentives and rebates that can potentially bring down the installation cost of the ECMs and result in a higher return on investment and quicker payback period.

The approach taken in the solar photovoltaic (PV) roof analysis begins with surveying the roof and determine areas on the roof where solar PV panels can potentially be installed.

- 1) Conducting a preliminary sizing of solar PV panels on the roofs and on the ground and its potential electricity production for its first year of installment using the National Renewable Energy Laboratory (NREL) PV WATTS Version 2 Software.
- 2) Calculate energy and cost savings for the site as a sole proprietor of the system capable of collecting state, local, and federal tax credits and incentives and interconnecting and selling the renewable energy electrical production to the building.

| SOLAR ROOFTOP PHOTOVOLTAIC ANALYSIS | | |
|-------------------------------------|-----------|-------|
| Estimated Number of Panels | 578 | |
| Estimated KW Rating | 182 | KW |
| Potential Annual kWh Produced | 283,548 | kWh |
| % of Current Electricity Uses | 60.8% | |
| FINANCIAL SUMMARY | | |
| Investment Cost | \$637,350 | |
| Estimated Energy Cost Savings | \$45,368 | |
| Payback without Incentives | 14 | Years |
| Incentive Payback but without SRECs | 8.5 | Years |
| Payback with All Incentives | 8.5 | Years |

A photovoltaic array is a linked collection of photovoltaic modules, which are in turn made of multiple interconnected solar cells. The cells convert solar energy into direct current. Modules of cells are linked together to form an array. Most PV arrays use an inverter to convert the DC power produced by the modules into alternating current that can connect to existing AC infrastructure to power lights, motors, and other loads.

Cost of production has fallen years with increasing demand and through production and technological advances. The cost dropped from \$8–10/watt in 1996 to \$4–7/watt in 2006. The market is diversifying with new types of panels suited to unique installation methods including stick on sheets and PV spray coating. The solar PV cost used in the analysis was set at \$7.0/Watt which includes design, construction, administration, and installation and maintenance cost throughout the life of the solar panels.

One breakthrough for PV is “Net Metering”. When more PV electric power is generated than is consumed on site, the electric service meter reverses to “sell” the excess power directly back onto the power grid. The economics of PV for commercial industrial installations become attractive when coupled with incentives from Federal and state agencies, as well utility companies.

A kilowatt-hour costing \$0.15 might be valued at \$0.30 when produced by PV and sent to the grid. The economics of PV for commercial industrial installations become attractive when coupled with incentives from Federal and state agencies, as well utility companies.

The low payback period is highly dependent on the marketing potential of selling Solar Renewable Certificates to electricity generated providers who are under state regulations to contain a certain percentage of their electricity generation derived from renewable energy such as wind and solar.

Solar facilities are encouraged to sell their SRECs on the market (either spot market or through long-term contracts). Utilities may use SRECs for compliance under the state RPS for the year in which they are generated. Utilities may purchase up to 10% more SRECs than they require for compliance and “bank” those surplus SRECs for compliance during the following two years. Any SRECs pricing can range from \$300 - \$450/MWh and can be sold across state borders to other utility providers looking to purchase SRECs. EMG has selected to use the market value of \$300/MWh minus 5% administrative fee in the analysis.

A number of states and corresponding electrical utility supplier are required under regulation to have a certain percentage of its electricity be produced by solar energy. To offset that they allow other utility companies to buy Renewable Energy Credits (REC) credit off their customers and facilities that produce their own solar energy. Typically, the national market, the utility market is \$400 per MWh to Utility Suppliers for not meeting this standard percentage so these REC credits are sold for \$350 per MWh. (1 REC credit = 1 MWh).

State charges these utility companies to meet their state compliance of 0.2% of the entire electricity consumption from solar energy by 2022 (from 0.005% in 2008 aggregated up to 0.2% by 2022). The REC credits correspond to these percentages as they aggregate each year.

6. Operations and Maintenance Plan

The quality of the maintenance and the operation of the facility's energy systems have a direct effect on its overall energy efficiency. Energy-efficiency needs to be a consideration when implementing facility modifications, equipment replacements, and general corrective actions. The following is a list of activities that should be performed as part of the routine maintenance program for the property.

Building Envelope

- ✓ Ensure that the building envelope has proper caulking and weather stripping.
- ✓ Patch holes in the building envelope with foam insulation and fire rated caulk around combustion vents
- ✓ Inspect building vents semiannually for bird infestation
- ✓ Inspect windows monthly for damaged panes and failed thermal seals
- ✗ Repair and adjust automatic door closing mechanisms as needed.

Heating and Cooling

- ✓ Pilots lights on furnaces and boilers be turned off in summer
- ✗ All preventive maintenance should be performed on all furnaces and boilers, which would include cleaning of burners and heat exchanger tubes.
- ✗ Ensure that the combustion vents exhaust outside the conditioned space and the vent dampers are functional
- ✗ Ensure that the control valves are functioning properly before start of every season
- ✗ Ensure steam traps are functional before start of each heating season
- ✗ Ensure use of chemical treatment for boiler make up water
- ✗ Ensure boiler outside temperature re-set is set to 55F
- ✗ Ensure use of chemical treatment for Colling tower water to prevent corrosion
- ✓ Ensure the duct work in unconditioned space is un-compromised and well insulated
- ✓ Duct cleaning is recommended every 10 years. This should include sealing of ducts using products similar to 'aero-seal'
- ✓ Ensure use of economizer mode is functional and used
- ✓ Ensure that the outside air dampers actuators are operating correctly
- ✓ Ensure air coils in the AHU and FCA's are pressure washed annually
- ✓ Return vents should remain un-obstructed and be located centrally
- ✓ Temperature settings reduced in unoccupied areas and set points seasonally adjusted.
- ✓ Evaporator coils and condenser coils should be regularly cleaned to improve heat transfer
- ✓ Refrigerant pipes should be insulated with a minimum of ¾" thick Elastomeric Rubber Pipe Insulation
- ✓ Ensure refrigerant pressure is maintained in the condensers
- ✓ Change air filters on return vents seasonally. Use only filters with 'Minimum Efficiency Rating Value'(MERV) of 8

Central Domestic Hot Water Heater

- ✓ Never place gas fired water heaters adjacent to return vents so as to prevent flame roll outs
- ✓ Ensure the circulation system is on timer to reduce the losses through re-circulation
- ✓ Ensure all hot water pipes are insulated with fiberglass insulation at all times
- ✓ Replacement water heater should have Energy Factor (EF)>0.9
- ✓ Tank-type water heaters flushed monthly

Lighting Improvements

- ✓ Utilize bi-level lighting controls in stairwells and hallways.
- ✓ Use LED replacement lamps
- ✓ Clean lighting fixture reflective surfaces and translucent covers.
- ✓ Ensure that timers and/or photocells are operating correctly on exterior lighting
- ✓ Use occupancy sensors for offices and other rooms with infrequent occupancy

Existing Equipment and Replacements

- ✓ Ensure that refrigerator and freezer doors close and seal correctly
- ✓ Ensure kitchen and bathroom exhaust outside the building and the internal damper operates properly
- ✓ Ensure that bathroom vents exhaust out
- ✓ Office/ computer equipment either in the “sleep” or “off” mode when not used

7. Appendices

APPENDIX A: Glossary of Terms

APPENDIX B: Mechanical Equipment Inventory

APPENDIX C: Lighting System Schedule

APPENDIX D: ECM Checklist

APPENDIX E: ECM Calculations

APPENDIX F: Solar PV

APPENDIX A: Glossary of Terms

Glossary of Terms and Acronyms

ECM – Energy Conservation Measures are projects recommended to reduce energy consumption. These can be No/Low cost items implemented as part of routine maintenance or Capital Cost items to be implemented as a capital improvement project.

Initial Investment – The estimated cost of implementing an ECM project. Estimates typically are based on R.S. Means Construction cost data and Industry Standards.

Annual Energy Savings – The reduction in energy consumption attributable to the implementation of a particular ECM. These savings values do not include the interactive effects of other ECMs.

Cost Savings – The expected reduction in utility or energy costs achieved through the corresponding reduction in energy consumption by implementation of an ECM.

Simple Payback Period – The number of years required for the cumulative value of energy or water cost savings less future non-fuel or non-water costs to equal the investment costs of the building energy or water system, without consideration of discount rates.

EUL – Expected Useful Life is the estimated lifespan of a typical piece of equipment based on industry accepted standards.

RUL – Remaining Useful Life is the EUL minus the effective age of the equipment and reflects the estimated number of operating years remaining for the item.

SIR - The savings-to-investment ratio is the ratio of the present value savings to the present value costs of an energy or water conservation measure. The numerator of the ratio is the present value of net savings in energy or water and non-fuel or non-water operation and maintenance costs attributable to the proposed energy or water conservation measure. The denominator of the ratio is the present value of the net increase in investment and replacement costs less salvage value attributable to the proposed energy or water conservation measure. It is recommended that energy-efficiency recommendations be based on a calculated SIR, with larger SIRs receiving a higher priority. A project typically is recommended only if the SIR is greater than or equal to 1.0, unless other factors outweigh the financial benefit.

Life Cycle Cost - The sum of the present values of (a) Investment costs, less salvage values at the end of the study period; (b) Non-fuel operation and maintenance costs; (c) Replacement costs less salvage costs of replaced building systems; and (d) Energy and/or water costs.

Life Cycle Savings – The sum of the estimated annual cost savings over the EUL of the recommended ECM, expressed in present value dollars.

Building Site Energy Use Intensity - The sum of the total site energy use in thousands of Btu per unit of gross building area. Site energy accounts for all energy consumed at the building location only not the energy consumed during generation and transmission of the energy to the site.

Building Source Energy Use Intensity – The sum of the total source energy use in thousands of Btu per unit of gross building area. Source energy is the energy consumed during generation and transmission in supplying the energy to your site.

Building Cost Intensity - This metric is the sum of all energy use costs in dollars per unit of gross building area.

Greenhouse Gas Emissions - Although there are numerous gases that are classified as contributors to the total for Greenhouse Emissions, the scope of this energy audit focuses on carbon dioxide (CO₂). Carbon dioxide enters the atmosphere through the burning of fossil fuels (oil, natural gas, and coal), solid waste, trees and wood products, and also as a result of other chemical reactions (e.g., manufacture of cement).

APPENDIX B: Mechanical Equipment Inventory

| Mechanical Inventory | | | | | | | |
|---------------------------|---------------------|--------------------|--------------------|----------------|--|--------------------------|--|
| System | Make | Model | Serial Number | Input Capacity | Location | Location- Floor | |
| Water Heater | Rheem / Ruud | E10-12-G | CS0203RR0103E0081 | 10 GAL | John Still Middle (East Campus) / 00F Multipurpose | Scullery-K006 | |
| Water Heater | Wesix | N4657 | 150IV25E3 | 150 GAL | John Still Middle (East Campus) / 00B Office, Classrooms | Mechanical-M031 | |
| Water Heater | Bradford White | M-I-20V533-12 | HL9885971 | 20 GAL | John Still Middle (East Campus) / 00G Classrooms | Janitor-J027 | |
| Water Heater | A. O. Smith | BTH 250 966 | MK98-0777259-966 | 100 GAL | John Still Middle (East Campus) / 00D Gymnasium | West Mech Rm | |
| Water Heater | Rheem / Ruud | ES85-9-G | CS0800 RR0500E0018 | 85 GAL | John Still Middle (East Campus) / 00C Classrooms | Storage-S018 | |
| Water Heater | A. O. Smith | BTH 250 966 | ML98-0784358-966 | 100 GAL | John Still Middle (East Campus) / 00D Gymnasium | East Mech Rm | |
| Water Heater | A. O. Smith | BTR 154 106 | ME000937848 | 81 GAL | John Still Middle (East Campus) / 00E Classrooms | Mechanical-B001 | |
| Water Storage Tank | | | | 3700 GAL | John Still Middle (East Campus) / 00E Classrooms | Boiler room-B001 | |
| Water Storage Tank | | | | 530 GAL | John Still Middle (East Campus) / 00E Classrooms | Boiler room-B001 | |
| Boiler | Lochinvar | Outdoor Knight | Inaccessible | 700 MBH | John Still Middle (East Campus) / 00B Office, Classrooms | Roof | |
| Condensing Unit/Heat Pump | Carrier | 38EZA048500 | 2400E02716 | 4 TON | John Still Middle (East Campus) / 00A Classrooms | Classroom-0010 | |
| Condensing Unit/Heat Pump | Carrier | 38EZA048500 | 2400E07975 | 4 TON | John Still Middle (East Campus) / 00A Classrooms | Classroom-0005 | |
| Condensing Unit/Heat Pump | Carrier | 38EZA048500 | 2400E07987 | 4 TON | John Still Middle (East Campus) / 00A Classrooms | Classroom-0004 | |
| Condensing Unit/Heat Pump | Carrier | 38EZA042500 | 1600E07311 | 3.5 TON | John Still Middle (East Campus) / 00B Office, Classrooms | Classroom-0015 | |
| Condensing Unit/Heat Pump | Carrier | 38EZA042500 | 1600E07317 | 3.5 TON | John Still Middle (East Campus) / 00B Office, Classrooms | Classroom-0016 | |
| Condensing Unit/Heat Pump | Carrier | 38EZA042500 | 2400E07315 | 3.5 TON | John Still Middle (East Campus) / 00B Office, Classrooms | Classroom-0017 | |
| Condensing Unit/Heat Pump | Carrier | 38EZA042501 | 1600E07319 | 3.5 TON | John Still Middle (East Campus) / 00B Office, Classrooms | Classroom-0017 | |
| Condensing Unit/Heat Pump | Carrier | 38EZA042500 | 2400E07310 | 3.5 TON | John Still Middle (East Campus) / 00B Office, Classrooms | Classroom-0003 | |
| Condensing Unit/Heat Pump | Carrier | 38EZA042500 | 2400E07322 | 3.5 TON | John Still Middle (East Campus) / 00B Office, Classrooms | Classroom-0003 | |
| Condensing Unit/Heat Pump | Carrier | 38EZA048500 | 2400E07312 | 3.5 TON | John Still Middle (East Campus) / 00B Office, Classrooms | Classroom-0203 | |
| Condensing Unit/Heat Pump | Carrier | 38EZA048500 | 2400E07973 | 4 TON | John Still Middle (East Campus) / 00A Classrooms | Library-X012 | |
| Condensing Unit/Heat Pump | Carrier | 38EZA048500 | 2400E07964 | 4 TON | John Still Middle (East Campus) / 00B Office, Classrooms | Classroom-0207 | |
| Condensing Unit/Heat Pump | Carrier | 38EZA048500 | 2400E07992 | 4 TON | John Still Middle (East Campus) / 00B Office, Classrooms | Classroom-0208 | |
| Condensing Unit/Heat Pump | Carrier | 38EZA048500 | 2400E07993 | 4 TON | John Still Middle (East Campus) / 00B Office, Classrooms | Classroom-0209 | |
| Condensing Unit/Heat Pump | Carrier | 38EZA048501 | 2400E07991 | 3.5 TON | John Still Middle (East Campus) / 00B Office, Classrooms | Classroom-0210 | |
| Condensing Unit/Heat Pump | Carrier | 38EZA048500 | 2400E07990 | 4 TON | John Still Middle (East Campus) / 00B Office, Classrooms | Classroom-0205 | |
| Condensing Unit/Heat Pump | Carrier | 38EZA048500 | 2400E07989 | 4 TON | John Still Middle (East Campus) / 00A Classrooms | Library-X012 | |
| Condensing Unit/Heat Pump | Carrier | 38EZA048500 | 2400E07980 | 4 TON | John Still Middle (East Campus) / 00A Classrooms | Classroom-0014 | |
| Condensing Unit/Heat Pump | Carrier | 38EZA048500 | 2400E02958 | 4 TON | John Still Middle (East Campus) / 00A Classrooms | Classroom-0009 | |
| Condensing Unit/Heat Pump | Carrier | 38EZA048500 | 2400E02991 | 4 TON | John Still Middle (East Campus) / 00A Classrooms | Classroom-0008 | |
| Condensing Unit/Heat Pump | Carrier | 38EZA048500 | 2400E07965 | 4 TON | John Still Middle (East Campus) / 00A Classrooms | Classroom-0006 | |
| Condensing Unit/Heat Pump | Gemini | 38AUZA12A0A6A0A0A0 | 3816C90214 | 8.3 TON | John Still Middle (East Campus) / 00B Office, Classrooms | Office | |
| Condensing Unit/Heat Pump | Gemini | 38AUZA12A0A6A0A0A0 | 3816C90248 | 8.3 TON | John Still Middle (East Campus) / 00B Office, Classrooms | Office | |
| Condensing Unit/Heat Pump | Rheem | RAKA-060DAS | 4995F269917011 | 5 TON | John Still Middle (East Campus) / 00G Classrooms | Classrooms | |
| Condensing Unit/Heat Pump | Rheem | RAKA-060DAS | 4995F269917002 | 5 TON | John Still Middle (East Campus) / 00G Classrooms | Classrooms | |
| Condensing Unit/Heat Pump | Rheem | RAKA-060DAS | Illegible | 5 TON | John Still Middle (East Campus) / 00G Classrooms | Classrooms | |
| Condensing Unit/Heat Pump | Mitsubishi Electric | PUZ-A24NHA6 | 52U04504B | 2 TON | John Still Middle (East Campus) / 00B Office, Classrooms | Building exterior | |
| Ductless Split System | Mitsubishi Electric | Illegible | Illegible | 3 TON | John Still Middle (East Campus) / 00F Multipurpose | Kitchen-K006 | |
| Air Handler (AHU) | Carrier | 40RUAA07A2A6A0A1A0 | 3816U28756 | 2400 CFM | John Still Middle (East Campus) / 00B Office, Classrooms | Mechanical-M007 | |
| Air Handler (AHU) | Carrier | 40RUAA07A2A6A0A1A0 | 3816U28758 | 2400 CFM | John Still Middle (East Campus) / 00B Office, Classrooms | Mechanical-M007 | |
| Air Handler (AHU) | Lennox | Inaccessible | Inaccessible | 2000 CFM | John Still Middle (East Campus) / 00G Classrooms | Classroom-0029 | |
| Air Handler (AHU) | Lennox | No tag/plate found | CT-95V-1FW | 2000 CFM | John Still Middle (East Campus) / 00G Classrooms | Classroom-0027 | |
| Air Handler (AHU) | Lennox | No tag/plate found | No tag/plate found | 2000 CFM | John Still Middle (East Campus) / 00G Classrooms | Classroom-0028 | |
| Make-Up Air Unit | Reznor | No tag/plate found | No tag/plate found | 4000 CFM | John Still Middle (East Campus) / 00D Gymnasium | Roof, boys' locker room | |
| Make-Up Air Unit | Reznor | No tag/plate found | No tag/plate found | 4000 CFM | John Still Middle (East Campus) / 00D Gymnasium | Roof, girls' locker room | |
| Make-Up Air Unit | Reznor | No tag/plate found | No tag/plate found | 4000 CFM | John Still Middle (East Campus) / 00D Gymnasium | Roof, boys' locker room | |
| Make-Up Air Unit | Reznor | No tag/plate found | No tag/plate found | 2000 CFM | John Still Middle (East Campus) / 00D Gymnasium | Roof, girls' locker room | |
| Exhaust Fan | | 302RCRK | No tag/plate found | 2000 CFM | John Still Middle (East Campus) / 00E Classrooms | Roof | |
| Exhaust Fan | | | | 800 CFM | John Still Middle (East Campus) / 00E Classrooms | Roof | |
| Exhaust Fan | | | | 800 CFM | John Still Middle (East Campus) / 00D Gymnasium | Roof | |
| Exhaust Fan | | | | 800 CFM | John Still Middle (East Campus) / 00F Multipurpose | Roof | |
| Exhaust Fan | JennAir | No tag/plate found | No tag/plate found | 1200 CFM | John Still Middle (East Campus) / 00D Gymnasium | Roof | |
| Exhaust Fan | JennAir | 1118CR A | No tag/plate found | 1200 CFM | John Still Middle (East Campus) / 00D Gymnasium | Roof | |
| Exhaust Fan | JennAir | 111 GRA | No tag/plate found | 1500 CFM | John Still Middle (East Campus) / 00F Multipurpose | Roof | |
| Exhaust Fan | No tag/plate found | No tag/plate found | No tag/plate found | 800 CFM | John Still Middle (East Campus) / 00F Multipurpose | Roof | |
| Furnace | Carrier | 58MXA060-16 | 2400A03700 | 60 MBH | John Still Middle (East Campus) / 00A Classrooms | Classroom-0010 | |
| Furnace | Carrier | Inaccessible | Inaccessible | 60 MBH | John Still Middle (East Campus) / 00A Classrooms | Classroom-0005 | |
| Furnace | Carrier | Inaccessible | Inaccessible | 60 MBH | John Still Middle (East Campus) / 00A Classrooms | Classroom-0004 | |
| Furnace | Carrier | 58MXA060-16 | 2400A03689 | 60 MBH | John Still Middle (East Campus) / 00B Office, Classrooms | Classroom-0015 | |
| Furnace | Carrier | 58MXA060-16 | 1600A13872 | 60 MBH | John Still Middle (East Campus) / 00B Office, Classrooms | Classroom-0016 | |
| Furnace | Carrier | 58MXA060-16 | 1600A13941 | 60 MBH | John Still Middle (East Campus) / 00B Office, Classrooms | Classroom-0017 | |
| Furnace | Carrier | 58MXA060-16 | 2100A00383 | 60 MBH | John Still Middle (East Campus) / 00B Office, Classrooms | Classroom-0017 | |
| Furnace | Carrier | 58MXA06013116 | 1600A13938 | 60 MBH | John Still Middle (East Campus) / 00B Office, Classrooms | Classroom-0003 | |
| Furnace | Carrier | 58MXA060-16 | 2400A03689 | 60 MBH | John Still Middle (East Campus) / 00B Office, Classrooms | Classroom-0003 | |
| Furnace | Carrier | 58MXA060-16 | 2400A03689 | 60 MBH | John Still Middle (East Campus) / 00B Office, Classrooms | Classroom-0203 | |
| Furnace | Carrier | 58MXA06013116 | 2400A03696 | 60 MBH | John Still Middle (East Campus) / 00A Classrooms | Library-X012 | |
| Furnace | Carrier | 58MXA060-16 | 2400A03689 | 60 MBH | John Still Middle (East Campus) / 00B Office, Classrooms | Classroom-0207 | |
| Furnace | Carrier | 58MXA06013116 | Inaccessible | 60 MBH | John Still Middle (East Campus) / 00B Office, Classrooms | Classroom-0208 | |
| Furnace | Carrier | 58MXA060-16 | 2400A03697 | 60 MBH | John Still Middle (East Campus) / 00B Office, Classrooms | Classroom-0209 | |
| Furnace | Carrier | 58MXA060-16 | 2400A03698 | 60 MBH | John Still Middle (East Campus) / 00B Office, Classrooms | Classroom-0210 | |
| Furnace | Carrier | 58MXA060-16 | 1700A22157 | 60 MBH | John Still Middle (East Campus) / 00B Office, Classrooms | Classroom-0205 | |
| Furnace | Carrier | 58MXA060-16 | 2400A03690 | 60 MBH | John Still Middle (East Campus) / 00A Classrooms | Library-X012 | |
| Furnace | Carrier | 58MXA060-16 | 2100A00377 | 60 MBH | John Still Middle (East Campus) / 00A Classrooms | Classroom-0014 | |
| Furnace | Carrier | Inaccessible | Inaccessible | 60 MBH | John Still Middle (East Campus) / 00A Classrooms | Classroom-0009 | |
| Furnace | Carrier | Inaccessible | Inaccessible | 60 MBH | John Still Middle (East Campus) / 00A Classrooms | Classroom-0008 | |
| Furnace | Carrier | Inaccessible | Inaccessible | 60 MBH | John Still Middle (East Campus) / 00A Classrooms | Classroom-0006 | |
| Furnace | Carrier | 58MXA06013116 | 1600A13876 | 60 MBH | John Still Middle (East Campus) / 00B Office, Classrooms | Classroom-0015 | |
| Packaged Unit (RTU) | Illegible | Illegible | Illegible | 4 TON | John Still Middle (East Campus) / 00E Classrooms | Classroom-N026 | |
| Packaged Unit (RTU) | Carrier | Illegible | Illegible | 5 TON | John Still Middle (East Campus) / 00A Classrooms | Classroom-0011 | |
| Packaged Unit (RTU) | Carrier | 48GS-060090601 | 2500G10736 | 5 TON | John Still Middle (East Campus) / 00B Office, Classrooms | Classroom-0206 | |
| Packaged Unit (RTU) | Carrier | 48GS-060090601 | 1900G10800 | 5 TON | John Still Middle (East Campus) / 00B Office, Classrooms | Classroom-0204 | |
| Packaged Unit (RTU) | Carrier | 48GS-060090601 | 2400G14108 | 5 TON | John Still Middle (East Campus) / 00B Office, Classrooms | Classroom-0203 | |
| Packaged Unit (RTU) | Carrier | 48GS-060090601 | 1900G10798 | 5 TON | John Still Middle (East Campus) / 00B Office, Classrooms | Classroom-0202 | |
| Packaged Unit (RTU) | Carrier | 48GS-060090601 | 2000G14135 | 5 TON | John Still Middle (East Campus) / 00B Office, Classrooms | Classroom-0201 | |
| Packaged Unit (RTU) | Carrier | 48GS-060090601 | 1800G10407 | 5 TON | John Still Middle (East Campus) / 00C Classrooms | Classroom-0019 | |
| Packaged Unit (RTU) | Carrier | 48GS-060090601 | 1600G14689 | 5 TON | John Still Middle (East Campus) / 00C Classrooms | Classroom-0018 | |
| Packaged Unit (RTU) | Carrier | 48GS-060090601 | 1900G10275 | 5 TON | John Still Middle (East Campus) / 00C Classrooms | Classroom-0020 | |
| Packaged Unit (RTU) | Carrier | 48GS-060090601 | 2400G14110 | 5 TON | John Still Middle (East Campus) / 00C Classrooms | Classroom-0021 | |
| Packaged Unit (RTU) | Carrier | 48GS-048090601 | 2900G10454 | 4 TON | John Still Middle (East Campus) / 00E Classrooms | Classroom-N022 | |
| Packaged Unit (RTU) | Carrier | 48GS-048090601 | 2900G10453 | 4 TON | John Still Middle (East Campus) / 00E Classrooms | Classroom-N023 | |
| Packaged Unit (RTU) | Carrier | 48GS-048090601 | 2900G10452 | 4 TON | John Still Middle (East Campus) / 00E Classrooms | Classroom-N024 | |
| Packaged Unit (RTU) | Carrier | 48GS-048090601 | 2900G10455 | 4 TON | John Still Middle (East Campus) / 00E Classrooms | Classroom-N025 | |

| Mechanical Inventory | | | | | | |
|----------------------|---------|------------------|---------------|----------------|--|-----------------------|
| System | Make | Model | Serial Number | Input Capacity | Location | Location- Floor |
| Packaged Unit (RTU) | Carrier | 48GS-024040301 | 3500G14298 | 2 TON | John Still Middle (East Campus) / 00E Classrooms | Classroom-N026 |
| Packaged Unit (RTU) | Carrier | 48JD028 | 2700F14621 | 25 TON | John Still Middle (East Campus) / 00F Multipurpose | Multipurpose-L006 |
| Packaged Unit (RTU) | Carrier | 48GS-036060601 | 2200G1055 | 3 TON | John Still Middle (East Campus) / 00F Multipurpose | Teachers' Dining-D006 |
| Packaged Unit (RTU) | Carrier | 48GS-030040501-- | 3300G10397 | 2.5 TON | John Still Middle (East Campus) / 00F Multipurpose | Staff Lounge-1006 |
| Packaged Unit (RTU) | Carrier | 48GS-024040301-- | 3500G14302 | 2 TON | John Still Middle (East Campus) / 00F Multipurpose | Staff Lounge-1006 |
| Packaged Unit (RTU) | Carrier | 48GS-036060601 | 2200G10558 | 3 TON | John Still Middle (East Campus) / 00F Multipurpose | Kitchen-K006 |
| Packaged Unit (RTU) | Carrier | 48GS-0180401 | 3700G109 | 1.5 TON | John Still Middle (East Campus) / 00A Classrooms | Classroom-O013 |
| Packaged Unit (RTU) | Carrier | 48GS-042060601 | 1400G10165 | 5 TON | John Still Middle (East Campus) / 00A Classrooms | Classroom-O007 |

APPENDIX C: Lighting System Schedule

| | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
|--------|----------|----------|---|--------------------|-----------|-----|---|---------------------|--------------------|-------------|-----------|-----|---------------------|----|---|----|-------|-------|--|--|--|-------|--|-----|--|--|---------|---------|
| 60 | O0B | Interior | 1 | OFFICE | C011 | 515 | 1 | Light Switch | Linear Fluorescent | T5 | 4' 28W T5 | 18 | 1x4 Prism Troffer | 2 | 0 | 8 | 2,220 | 1,119 | | | | | | | | | | |
| 61 | O0B | Interior | 1 | OPEN OFFICE | Counselor | - | 1 | Light Switch | Linear Fluorescent | T5 | 4' 28W T5 | 4 | 1x4 Prism Troffer | 2 | 0 | 8 | 2,220 | 249 | | | | | | | | | | |
| 62 | O0B | Interior | 1 | OPEN OFFICE | Counselor | - | 1 | Light Switch | Incan/H/MR | Incan | I75-A19 | 2 | Can-Surf Mount | 2 | 0 | 8 | 2,220 | 333 | | | | | | | | | | |
| 63 | O0B | Interior | 1 | OPEN OFFICE | Counselor | - | 1 | Light Switch | Linear Fluorescent | T5 | 4' 28W T5 | 8 | Industrial | 2 | 0 | 8 | 2,220 | 497 | | | | | | | | | | |
| 64 | O0B | Interior | 1 | OFFICE | C017 | 300 | 6 | Wall-Mounted Sensor | Linear Fluorescent | T5 | 4' 28W T5 | 24 | 1x4 Prism Troffer | 12 | 0 | 8 | 2,220 | 1,492 | | | | | | | | | | |
| 65 | O0B | Interior | 1 | OFFICE | C021 | 704 | 1 | Wall-Mounted Sensor | Linear Fluorescent | T5 | 4' 28W T5 | 24 | Industrial | 2 | 0 | 8 | 2,220 | 1,492 | | | | | | | | | | |
| 66 | O0B | Interior | 1 | RESTROOM - PRIVATE | T022 | 365 | 1 | Wall-Mounted Sensor | Linear Fluorescent | T5 | 4' 28W T5 | 2 | 1x4 Prism Troffer | 1 | 0 | 8 | 1,480 | 83 | | | | | | | | | | |
| 67 | O0C | Interior | 1 | CLASSROOM | O019 | 340 | 3 | Wall-Mounted Sensor | Linear Fluorescent | T5 | 4' 28W T5 | 81 | Industrial | 3 | 0 | 8 | 1,480 | 3,357 | | | | | | | | | | |
| 68 | O0C | Interior | 1 | STORAGE | S019 | - | 2 | Light Switch | Linear Fluorescent | T5 | 4' 28W T5 | 16 | 2x4 Prism Troffer | 4 | 0 | 8 | 1,480 | 663 | | | | | | | | | | |
| 69 | O0C | Interior | 1 | CLASSROOM | O021 | 778 | 6 | Light Switch | Linear Fluorescent | T5 | 4' 28W T5 | 162 | 2x4 Prism Troffer | 6 | 0 | 8 | 1,480 | 6,713 | | | | | | | | | | |
| 70 | O0C | Interior | 1 | CLASSROOM | O021 | 778 | 6 | Light Switch | Linear Fluorescent | T5 | 4' 28W T5 | 8 | 1x4 Prism Troffer | 4 | 0 | 10 | 1,480 | 332 | | | | | | | | | | |
| 71 | O0C | Interior | 1 | CLASSROOM | O021 | 778 | 6 | Light Switch | Linear Fluorescent | T5 | 4' 28W T5 | 32 | 2x2 Prism Troffer | 8 | 0 | 7 | 1,480 | 1,326 | | | | | | | | | | |
| 72 | O0C | Interior | 1 | CLASSROOM | O018 | 633 | 2 | Light Switch | Linear Fluorescent | T5 | 4' 28W T5 | 81 | 2x4 Prism Troffer | 3 | 0 | 8 | 1,480 | 3,357 | | | | | | | | | | |
| 73 | O0C | Interior | 1 | CLASSROOM | O018 | 633 | 2 | Light Switch | Linear Fluorescent | T5 | 4' 28W T5 | 4 | 1x4 Prism Troffer | 2 | 0 | 10 | 1,480 | 166 | | | | | | | | | | |
| 74 | O0C | Interior | 1 | RESTROOM | T018 | 528 | 1 | Timer | Linear Fluorescent | T5 | 4' 28W T5 | 8 | 1x4 Prism Troffer | 2 | 0 | 8 | 1,480 | 332 | | | | | | | | | | |
| 75 | Exterior | Exterior | 1 | CLASSROOM | Exterior | - | 1 | Timer | CFL | CFL - 4 Pin | CFL9 | 1 | Surface Mount Can | 1 | 0 | 15 | 2,220 | 20 | | | | | | | | | | |
| 76 | Exterior | Exterior | 1 | CLASSROOM | Exterior | - | 1 | Timer | CFL | CFL - 4 Pin | CFL9 | 6 | Surface Mount Can | 6 | 0 | 9 | 2,220 | 120 | | | | | | | | | | |
| 77 | Exterior | Exterior | 1 | CLASSROOM | Exterior | - | 1 | Timer | CFL | CFL - 4 Pin | CFL9 | 4 | Surface Mount Can | 4 | 0 | 9 | 2,220 | 80 | | | | | | | | | | |
| 78 | Exterior | Exterior | 1 | CLASSROOM | Exterior | - | 1 | Timer | CFL | CFL - 2 Pin | CFL28 | 8 | Surface Mount Can | 8 | 0 | 10 | 2,220 | 497 | | | | | | | | | | |
| 79 | Exterior | Exterior | 1 | CLASSROOM | Exterior | - | 1 | Timer | CFL | CFL - 2 Pin | CFL28 | 6 | Surface Mount Can | 6 | 0 | 14 | 2,220 | 373 | | | | | | | | | | |
| 80 | Exterior | Exterior | 1 | CLASSROOM | Exterior | - | 1 | Timer | CFL | CFL - 2 Pin | CFL28 | 5 | Surface Mount Can | 5 | 0 | 10 | 2,220 | 311 | | | | | | | | | | |
| 81 | Exterior | Exterior | 1 | CLASSROOM | Exterior | - | 1 | Timer | CFL | CFL - 2 Pin | CFL28 | 70 | Surface Mount Can | 70 | 0 | 8 | 2,220 | 4,351 | | | | | | | | | | |
| 82 | Exterior | Exterior | 1 | CLASSROOM | Exterior | - | 1 | Timer | CFL | CFL - 2 Pin | CFL28 | 4 | Surface Mount Can | 4 | 0 | 13 | 2,220 | 249 | | | | | | | | | | |
| 83 | Exterior | Exterior | 1 | CLASSROOM | Exterior | - | 1 | Timer | HID | MH | MH250 | 4 | Wallpack-Horizontal | 4 | 0 | 9 | 2,220 | 2,220 | | | | | | | | | | |
| 84 | Exterior | Exterior | 1 | CLASSROOM | Exterior | - | 1 | Timer | HID | MH | MH250 | 2 | Wallpack-Horizontal | 2 | 0 | 11 | 2,220 | 1,110 | | | | | | | | | | |
| 85 | Exterior | Exterior | 1 | CLASSROOM | Exterior | - | 1 | Timer | HID | MH | MH250 | 2 | Wallpack-Horizontal | 2 | 0 | 15 | 2,220 | 1,110 | | | | | | | | | | |
| Totals | | | | | | | | | | | | | | | | | | | | | | 3,670 | | 615 | | | 149,739 | 168,897 |

APPENDIX D: ECM Checklist

| NA | In Place | Evaluate | ECM Description |
|----|----------|----------|---|
| ✓ | | | Add Reflective Coating To Exterior Windows |
| ✓ | | | Replace External Windows |
| ✓ | | | Upgrade Insulation |
| ✓ | | | Control External Air Leakage In Commercial Buildings |
| ✓ | | | Install Reflective Insulation Between Radiators And External Wall |
| ✓ | | | Replace Existing Motors With High Efficiency Motors |
| | | | Install On-Demand Ventilation on Air Handlers |
| ✓ | | | Reduce HVAC Hours of Operation |
| ✓ | | | Install Variable Frequency Drives (VFD) |
| | ✓ | | Install Outside Air Temperature Reset Controls For Hot Water Boilers |
| | ✓ | | Install Chilled Water Reset Control |
| | | ✓ | Install Timers On Exhaust Fans |
| ✓ | | | Install Energy Savers on Vending, Snack Machines |
| ✓ | | | Install Building Energy Management System and Replace Terminal Units |
| | | ✓ | Re-Commission The Building & Its Control Systems |
| | ✓ | | Replace Inefficient Heating Plant |
| ✓ | | | Replace Inefficient Cooling Plant |
| ✓ | | | Replace Existing Air Conditioners with Energy Star Air Conditioners |
| ✓ | | | Replace Unit Electric Heaters with Natural Gas Fired Unit Heaters |
| | ✓ | | Convert From Gas Pilot to Electronic Ignition for Boilers |
| ✓ | | | Insulate Hot Water Pipes |
| | ✓ | | Insulate Refrigerant Lines |
| | ✓ | | Insulate Hot Surfaces And Tanks |
| | ✓ | | Insulate Air Ducts |
| ✓ | | | Replace Defective Steam Traps |
| | ✓ | | Upgrade Electric Heating System To Heat Pumps |
| | | ✓ | Replace Inefficient Furnace System |
| ✓ | | | Replace Rooftop Package Unit |
| | ✓ | | Install Energy Recovery Wheel on Air Handling Unit |
| | | ✓ | Replace Existing Water Heater With New Energy Efficient Units |
| | | ✓ | Replace Incandescent/Halogen Lamps With Energy Efficient Lamps |
| | | ✓ | Upgrade Inefficient Linear Fluorescent Lamps And Fixtures |
| ✓ | | | Upgrade EXIT SIGNS With LED EXIT Signs |
| ✓ | | | Bilevel and Tandem Linear Fluorescent Lighting ECM |
| | | ✓ | Replace High Intensity Discharge (HID) Lamps With Energy Efficient Lamps |
| ✓ | | | Replace Existing Refrigerator(s) With Energy Star Certified Refrigerator(s) |
| ✓ | | | Replace Existing Freezers With High Efficiency Freezers |
| | | | Install Low Flow Shower Heads |
| | | ✓ | Install Low Flow Faucet Aerators |
| ✓ | | | Install Low Flow Restroom Flush Tank Toilets |
| | | ✓ | Install Low Flow Tankless Restroom Fixtures |

APPENDIX E: ECM Calculations

| UIC | | Install Low Flow Faucet Aerators | |
|--|--|--|---|
| EAP2-b | Location: John Still Middle School - All Buildings | | |
| Property Type: | <input type="text" value="Commercial"/> | Estimated No. of Operational Weeks | <input type="text" value="37"/> |
| | | Number of Occupied Days/Week (Max 7) | <input type="text" value="5"/> |
| CLASSROOM FAUCETS | | BATHROOM FAUCETS | |
| Number of Occupants Affected By Retrofit | <input type="text" value="618"/> | Number of Occupants Affected by Retrofit | <input type="text" value="618"/> |
| Do You Want To Replace Kitchen Faucets Aerators | <input type="text" value="Yes"/> (Select) | Do You Want To Replace Bathroom Faucets Aerators | <input type="text" value="Yes"/> (Select) |
| Total Number of Faucet Aerators To Be Replaced | <input type="text" value="15"/> | Total Number of Faucet Aerators To Be Replaced | <input type="text" value="29"/> |
| Total Number of Faucets To Be Replaced: | <input type="text" value="0"/> | Total Number of Faucets To Be Replaced: | <input type="text" value="0"/> |
| GPM of Existing Faucet Aerators | <input type="text" value="2.2"/> GPM | GPM of Existing Faucet Aerators | <input type="text" value="2.2"/> GPM |
| GPM of Proposed Faucet Aerator | <input type="text" value="1.5"/> GPM | GPM of Proposed Faucet Aerator | <input type="text" value="0.5"/> GPM |
| Estimated Number of Uses Per Day | <input type="text" value="1"/> | Estimated Number of Uses Per Day | <input type="text" value="1"/> |
| Annual Water Savings From Installing Low Flow Aerators: | <input type="text" value="26.34"/> kGal | | |
| WATER & ENERGY SAVING CALCULATION | | COST SAVING CALCULATION | |
| Select Type of Water Heater Fuel: | <input type="text" value="Natural Gas"/> (Select) | Property Location in United States | <input type="text" value="North Central Localities"/> |
| Energy Factor of Domestic Hot Water Heater: | <input type="text" value="0.60"/> EF | Heating Fuel Tariff | <input type="text" value="\$1.29"/> \$/Therm |
| Hot Water Discharge Temperature at Faucet | <input type="text" value="110.00"/> °F | Water Tariff (\$/1000 Gal) | <input type="text" value="\$5.18"/> \$/kGal |
| Equivalent Heating Fuel Savings: <small>Savings Discounted by 15% to Account For Cold Water Use</small> | <input type="text" value="187"/> Therms | Annual Cost Savings In Form of Water | <input type="text" value="\$136"/> \$ |
| Annual Water Savings | <input type="text" value="26.34"/> kGal | Annual Energy Savings From Water Heater | <input type="text" value="\$242"/> \$ |
| COST BENEFIT ANALYSIS | | | |
| Estimated Total Annual Cost Savings | <input type="text" value="\$378"/> \$\$ | Estimated Total Installation Cost | <input type="text" value="\$670"/> \$\$ |
| Simple Payback Period | <input type="text" value="1.77"/> Years | Type of Recommendation | <input type="text" value="No/Low Cost ECM Recommendation"/> |

Disclaimer: PREPARED BY EMG. May 2016, INFORMATION CONTAINED IN THIS DOCUMENT IS PRIVILEGED AND CONFIDENTIAL "TRADE SECRET" AND IS THE SOLE PROPERTY OF EMG CORP. THIS MATERIAL MUST BE CONSIDERED PRIVILEGED AND CONFIDENTIAL BY ALL PARTIES PRIVY.

ECM EXPLANATION:

By reducing the flow of water coming from the restroom faucets, aerators can generate energy savings at low cost and with easy installation. The savings generated would be in the form of reduced water and sewer costs and at the same time aerators would save energy by reducing the demand for hot water. The average faucet has a flow rate of about 2 to 4 GPM. Adding a screw-in faucet aerator reduces the flow to 0.5 to 1.5 GPM in the bathroom and 2.2 GPM in the kitchen. In addition to saving energy and water, the "foamier" water that comes from faucet aerators wets objects better than water from a faucet with no aerator, which tends to bounce off the object rather than thoroughly wetting it.

EMG recommends replacing the proposed faucet aerators with new low flow aerators as mentioned above. The proposed ECM shall also result in an annual energy saving in form of reduction in water heating bills.

Summary:

Initial Investment: \$670 Estimated Annual Cost Savings: \$378 Simple Payback Period (Yrs): 1.77

Property of EMG Corp. All Rights Reserved

| | | | |
|---|--|----------|------|
| UIC | Install Low Flow Tankless Restroom Fixtures | | |
| EAP4 | Location: John Still Middle School - All Buildings | | |
| ECM FOR DETERMINING WATER SAVINGS IN COMMERCIAL PROPERTIES | | | |
| Number of Males | 309 | | |
| Number of Females | 309 | | |
| Number of Occupied Days Per Week (Max 7) | | 5 | |
| Number of Occupied Weeks/Year (Max 52) | | 37 | |
| Number of Urinals To Be Retrofitted | | 19 | |
| Number of Water Closets To Be Retrofitted | | 26 | |
| No. of Water Closets With Separate Flush Tank <small>(Typical Residential Type)</small> | | | |
| Estimated Restroom Usage/Individual/Day <small>Default is 4 Uses/Day For Residential/Office</small> | 2 | (Select) | |
| Urinal Water Savings | | | |
| Do you Want To Make Any Changes To The Urinals? | | Yes | |
| Estimated Existing Use of Urinal/Day/Man | | 80% | |
| Existing Gallons Per Flush Ratings For Urinal Flushes | | 1.00 | GPF |
| Proposed Urinal | 0.125 GPF -Wall Mount | | |
| GPF of Proposed Urinal Flush Valve** | | 0.125 | GPF |
| <small>**1992 EpACT Energy Act Mandates 1.0GPF Max on Urinals</small> | | | |
| Estimated Annual Water Savings From Urinal | | 80.03 | kGal |
| Water Closet Water Savings | | | |
| Tankless Water Closets | | | |
| Do The Water Closet Need To Be Retrofitted? | (Select) | Yes | |
| Existing Gallons Per Flush Ratings For Water Closet Flushes | | 1.60 | GPF |
| Are The Existing Water Closet Being Replaced? <small>(If No, Then Only The Flush Valve Would Be Replaced With Dual Flush Retrofit Kit)</small> | (Select) | No | |
| No. of Tankless Water Closets | | 26 | |
| GPF of Proposed Dual Flush- Water Closet Valve* | | 1.28 | GPF |
| <small>*Federal Law Requires All Flushes Not To Exceed 1.6 GPF</small> | | | |
| | <small>Solid Waste (20%)</small> | 1.00 | GPF |
| | <small>Liquid Waste (80%)</small> | | |
| Estimated Annual Water Savings From Male Users | | 12.44 | kGal |
| Estimated Annual Water Savings From Female Users | | 62.20 | kGal |
| Total Water Savings From Water Closets | | 74.63 | kGal |
| Water & Cost Saving Calculations | | | |
| Water Savings Calculation | | | |
| Water Savings By The Use of Low Flow Water Closet Flush Valves/Yr | | 74.63 | kGal |
| Water Savings By The Use of Low Flow Urinal Flush Valves/ Yr | | 80.03 | kGal |
| Total Annual Water Savings in kGal | | 154.67 | kGal |
| Cost Savings Calculations | | | |
| Enter Water Tariff Rate (\$/1000Gal) | | \$5.18 | \$\$ |
| Estimated Cost Savings From Water | | \$800 | \$\$ |
| Estimated Cost of Retrofit | | | |
| Cost For Replacing Existing Urinal Fixture With A Low Flow Fixture <small>(Includes Labor)</small> | | \$24,707 | \$\$ |
| Cost For Replacing Existing Flush Valves With Low Flow - Dual Flush Valves (\$80 Per Unit) <small>(Includes Labor)</small> | | \$16,095 | \$\$ |
| <small>(Up For Liquid Waste And Down For Solid Waste)</small> | | | |
| Estimated Total Cost For Retrofit | | \$40,802 | \$\$ |
| Simple Pay Back Period | | 50.98 | Yrs |
| Type of Recommendation | Capital Cost ECM Recommendation | | |

Disclaimer: PREPARED BY EMG, May2016, INFORMATION CONTAINED IN THIS DOCUMENT IS PRIVILEGED AND CONFIDENTIAL "TRADE SECRET" AND IS THE SOLE PROPERTY OF EMG CORP. THIS MATERIAL MUST BE CONSIDERED PRIVILEGED AND CONFIDENTIAL BY ALL PARTIES PRIVY.

ECM EXPLANATION:

The highest water utilization at any home/office occurs in the restrooms. It is estimated that on an average a normal human being uses the restroom at least four times a day. Keeping with the global water conservation objectives, federal law prohibits use of any new water closet flushes over 1.6 GPF. At the same time the '1992 EpACT' mandates all new Urinals to have a maximum 1.0 GPF flush valves on urinals.

EMG recommends replacing all urinals above 1.0 GPF with a new 0.5 GPF or lesser urinals. At the same time EMG also recommends replacing all the water closets having a GPF rating of 1.6 and over with low flow water closet fixtures equipped with dual flush valves.

In case the property doesn't wish to replace the entire water closet fixtures, EMG recommends retrofitting all the tankless water closet flush fixtures with new dual flush fixtures that would result in a 30% water savings per flush for liquid wastes, while retaining the same flush rate for solid wastes.

SUMMARY:

Initial Investment: \$40,802 Simple Payback Period: 50.98 Yrs
Annual Cost Savings: \$800

| <i>UIC</i> | Re-Commission The Building & Its Control Systems | |
|--|---|----------|
| EAC10 | Location: John Still Middle School - All Buildings | |
| Enter the Total Area of The Facility | 94,732 | SqFt |
| Select the Type of Heating Fuel: | Natural Gas | (Select) |
| Estimated Annual Heating Fuel Consumption: | 7,300 | Therms |
| Is the Property Cooled? | Yes | (Select) |
| Estimated Annual Electrical Energy Consumed For Cooling: | 92,000 | kWh |
| Estimated Energy Savings From Re-Commissioning on Building Systems: | 15% | (Select) |
| Estimated Heating Energy Saving Post Re-Commissioning: | 1,095 | Therms |
| Estimated Cooling Energy Saving Post Re-Commissioning: | 13,800 | kWh |
| Average Heating Fuel Rate Paid By The Property: | \$1.29 | \$/Therm |
| Average Electrical Rate Paid By The Property: | \$0.16 | \$/kWh |
| Annual Energy Cost Savings: | \$3,622 | \$ |
| Estimated Cost For Re-Commissioning The Facility: <i>(LBNL 2009 Report on Building Commissioning)</i> | \$42,418 | \$ |
| Simple Payback Period: | 11.71 | Yrs |
| <i>Type of Recommendation</i> | Capital Cost ECM Recommendation | |

Disclaimer: PREPARED BY EMG.May 2016, INFORMATION CONTAINED IN THIS DOCUMENT IS PRIVILEGED AND CONFIDENTIAL "TRADE SECRET" AND IS THE SOLE PROPERTY OF EMG CORP. THIS MATERIAL MUST BE CONSIDERED PRIVELEDGED AND CONFIDENTIAL BY ALL PARTIES PRIVY.

ECM DESCRIPTION

The goal of commissioning of a facility is to ensure that the equipments in the facility are performing as per the desired standards or as per design standards. The role of commissioning in existing buildings is to identify the almost inevitable "drift" from where things should be and puts the things back on track. Based on the LBNL 2009 Report on Building Commissioning the average re-commissioning of existing buildings yielded atleast 16% of energy savings across the facility. This average has been developed based on over 643 buildings that were commissioned across United States in different climatic zones.

Thus EMG strongly recommends re-commissioning of all existing buildings in order to ensure that all the sensors, equipments and control systems are working as per the design conditions.

SUMMARY:

Initial Investment: \$42,418 Simple Payback: 11.71 Years
 Energy Cost Savings: \$3,622

| UIC | Install Timers On Exhaust Fans | |
|---|---------------------------------|--|
| EAC7A | Location: All buildings | |
| Type of Exhaust Fan: | Rooftop Exhaust Fans | |
| EXISTING CONDITION | | |
| No. of Timers to Be Installed: | 4 Qty | HP of Individual Fan Motor: 0.17 HP |
| No. of Exhaust Fans: | 24 | Total kW: 3.04 kW |
| Existing Daily Hours of Operation/Exhaust Fan: | 15.00 Hrs/Day | Annual kWh For All Fans: 16,664 kWh |
| PROPOSED CONDITION | | |
| New Daily Hours With Timers/Exhaust Fan: | 12.00 Hrs/Day | New Annual kWh For All Fans: 13,331 kWh |
| Type of Heating Fuel: | Natural Gas | Is The Property Cooled? Yes |
| Only For Apt. Bathroom Exhaust Fans | | Only For Roof Top Exhaust Fans- Commerical Spaces |
| CFM for Individual Bathroom Exhaust Fans <i>(For bathrooms<100Sqft)</i> | 90 CFM | No. of Water Closets In Building 26 |
| Total Exhaust CFM From All Fans | 2,160 CFM | No. of Urinals In Building 19 |
| Annual Heating Energy Savings | 0 kbtu | Total CFM for All Restroom Exhaust 2,250 CFM |
| Annual Cooling Energy Savings | 0 kbtu | Annual Heating Energy Savings 29,160 kbtu |
| | | Annual Cooling Energy Savings 14,580 kbtu |
| Energy & Cost Savings | | |
| Estimated Annual Heating Plant Efficiency | 80.00 % | Estimated Annual Cooling Plant Efficiency 8.67 EER |
| Annual Heating Energy Savings | 365 Therms | Annual Cooling Energy Savings 1,682 kWh |
| Annual Electric Fan Motor Savings | 3,333 kWh | |
| COST ANALYSIS | | |
| Electric Rate: | \$0.16 \$/kWh | Total Annual Electric Savings 5,014 kWh |
| Material Cost For Timers: | \$677 \$ | Total Annual Non Electric Savings 365 Therms |
| Total Cost for Installing Timers | \$1,416 \$ | Annual Cost savings: \$1,273 \$ |
| Simple Payback: | 1.11 Yrs | |
| Type of Recommendation | Capital Cost ECM Recommendation | |

Disclaimer: PREPARED BY EMG. May 2016, INFORMATION CONTAINED IN THIS DOCUMENT IS PRIVILEGED AND CONFIDENTIAL "TRADE SECRET" AND IS THE SOLE PROPERTY OF EMG Corp. THIS MATERIAL MUST BE CONSIDERED PRIVELEDGED AND CONFIDENTIAL BY ALL PARTIES PRIVY.

ECM DESCRIPTION:

Exhaust fans are generally used in areas with high concentrations of pollutants generated from occupants' activities. These exhaust requirements are rarely continuous, and the fans should operate only as needed. Continuous operations of bathroom exhaust fans results in exhausting conditioned air out. This causes low pressures in the conditioned space, which is filled up by infiltrated air from unconditioned spaces. Air infiltration leads to increase loads on heating and cooling system increasing the energy consumed to condition the space. In addition to this the fan motor is also consumes energy to operate, though insignificant as compared to the HVAC losses.

In case of the residential properties with individual exhaust fans in the bathrooms, EMG recommends installing timer switches on each bathroom fan to control the fan operations. Bathroom fans are essential to exhaust out the excess humidity and odor control. The timer switch will limit the operation time to 20 mins.

In case of central exhaust systems that have roof top or side wall mounted exhaust fans, EMG recommends a single electronic timer control to restrict the exhaust fan operations to typical building occupancy hours +/- 2 hrs. A single electronic timer would be able to control all the exhaust fans.

Summary:

| | | | | |
|---------------------|---------|-----------------|------|-------|
| Initial Investment: | \$677 | Simple Payback: | 1.11 | Years |
| Energy Cost Savings | \$1,273 | | | |

| UIC | Replace Existing Water Heater With New Energy Efficient Units | | | | |
|--------|---|---------------------------------|----------------------------|----------------------|-----------------|
| EAD3 | Location: John Still Middle School | | | | |
| Step 1 | Existing Water Heater Details | 100 Gallon | 80 -85 Gallon | 150 Gallon | |
| | Number of Water Heaters Being Replaced: | 2 | 2 | 1 | |
| | Select Existing Hot Water Heater Fuel | Natural Gas | Electric | Electric | Electric |
| | Insert Energy Factor of Existing Water Heater | 0.60 EF | 0.80 EF | 0.80 EF | |
| | Input Existing Water Heater Input Rating | 240.00 kBtus | 36.00 kW | 120.00 kW | |
| | Select One Method For Calculation | Annual Heating Hours | Annual Heating Hours | Annual Heating Hours | Annual DWH Load |
| | Insert Average Annual Hours of Operation | 300 hrs | 70 hrs | 70 hrs | |
| | Annual Water Heater Energy Consumption/Heater | 720 Therms | 2,520 kWh | 8,400 kWh | #DIV/0! |
| | Total Estimated Annual Energy Consumption For all Heaters | 1,440 Therms | 5,040 kWh | 8,400 kWh | 0 kWh |
| | Total Estimated Annual Operating Energy Costs For all Heaters | \$1,863 \$ | \$805 \$ | \$1,342 \$ | \$0 \$ |
| Step 2 | Proposed New Water Heater | | | | |
| | Proposed Hot Water Heater Fuel | Natural Gas | Electric | Electric | Natural Gas |
| | Capacity of the Proposed New Water Heater | 100-Gal,250-kBtu | 80-Gal,4.5-kW | 120-Gal,6-kW | |
| | Energy Factor of Proposed Water Heater | 0.95 EF | 0.95 EF | 0.90 EF | 0.00 EF |
| | Proposed Water Heater Input Rating | 250.00 kBtu/h | 4.50 kW | 6.00 kW | 0.00 kBtu/h |
| | Annual kBtu/h Consumption For All The Proposed Water Heaters | 90,947 kBtu/h | 14,481 kBtu/h | 25,476 kBtu/h | #DIV/0! |
| | Estimated Annual Water Heater Fuel Consumption (All Heaters) | 909 Therms | 4,244 kWh | 7,467 kWh | 0 Therms |
| | Estimated Total Annual Energy Costs | \$1,177 \$ | \$678 \$ | \$1,193 \$ | \$0 \$ |
| Step 3 | Energy & Cost Saving Calculation | | | | |
| | Estimated Cost of New Water Heater/Unit | \$8,640 \$ | \$1,927 \$ | \$2,593 \$ | \$0 \$ |
| | Total Estimated Installation Cost | \$25,791 \$ | \$5,752 \$ | \$3,870 \$ | \$0 \$ |
| | Total Estimated Annual Cost Savings | \$687 \$ | \$127 \$ | \$149 \$ | \$0 \$ |
| | Total Annual Cost Savings: | \$963 | Total Initial Investment:: | \$35,413 | |
| | Simple Pay Back Period | 36.78 | | | |
| | <i>Type of Recommendation</i> | Capital Cost ECM Recommendation | | | |

Disclaimer: PREPARED BY EMG. DECEMBER 2016, INFORMATION CONTAINED IN THIS DOCUMENT IS PRIVILEGED AND CONFIDENTIAL "TRADE SECRET" AND IS THE SOLE PROPERTY OF EMG CORP. THIS MATERIAL MUST BE CONSIDERED PRIVILEGED AND CONFIDENTIAL BY ALL PARTIES PRIVY.

ECM SUMMARY:

Electric resistance is the most expensive method for heating domestic hot water. A natural gas or propane fired water system provide more units of heat with direct burning of fuel while high wattage draw is required for electric water heaters to create resistance heat. This electric usage can be seen with the increase power demand for the site and the additional kWh consumption. The installation process of the gas/propane fired water heater requires additional measures with tying a gas line or fuel tank to the system along with installing an exhaust gas vent. This process is not a costly retrofit if a current gas line or tank is at the site. The hot water exhaust duct can be tied to the existing gas fired furnaces or boilers for an easy retrofit.

SUMMARY:

Initial Investment: \$25,791 Simple Payback: 36.78 yrs
 Annual Cost Savings: \$687

| UIC | Replace Inefficient Furnace and Air Conditioning System | | |
|---|---|---|------------------------------------|
| EAH12-A | Location: John Still Middle - All Buildings Furnaces and Condensers | | |
| Estimated Annual Cooling Hours: | 500 Hrs | Estimated Annual Heating Hours: 400 Hrs | |
| Are The Condensing Units Being Replaced | Yes | Replace Furnace? Yes Heating Fuel: Natural Gas | |
| Existing Cooling System | | Existing Heating System | |
| No. of Cooling Plants To Be Replaced: | 22 | No. of Furnaces To Be Replaced: 22 | |
| Input the Btu/Hr of the air conditioner: | 48,000 | Input the MBH Rating of the Furnace: 60 MBH | |
| Input Existing EER of the Air Conditioner: | 8.67 | Input Existing AFUE for the Furnace: 90% | |
| Estimated Current Annual Energy Consumption For Cooling: <small>(For All Units)</small> | 60,900 kWh | Estimated Annual Current Energy Consumption For Heating: <small>(For All Units)</small> | 5,280 Therms |
| Proposed Cooling System | | Proposed Heating System | |
| Input the Btu/Hr of the Proposed Air Conditioner: | 48,000 Btuh | Proposed Furnace: Gas Fired -60MBH | |
| Input EER of the Proposed Air Conditioner: | 10.50 | Input AFUE for the Proposed Furnace: 96% | |
| Estimated Annual Energy Consumption With New AC's <small>(For One Unit)</small> | 2,286 kWh | Estimated Annual Energy Consumption With New Furnace <small>(For One Unit)</small> | 225 Therms |
| Energy & Cost Savings From New Cooling System | | Energy & Cost Savings From New Heating System | |
| Estimated Annual Energy Savings From New Cooling System: <small>(Total)</small> | 10,614 kWh | Estimated Annual Energy Consumptions From New Heating System: <small>(Total)</small> | 4,950 Therms |
| Average Electric Rate: | \$0.16 \$/kWh | Average Heating Fuel Cost For New Furnace: | \$1.29 \$/Therm |
| Estimated Annual Cost Savings From Cooling: | \$1,696 | Estimated Annual Cost Savings From Heating: | \$427 \$\$ |
| Estimated Cost of New Condensing Unit: <small>(Material + Installation+Labor)</small> | \$73,700 | Estimated Cost of New Furnace Unit: <small>(Material + Installation+Labor)</small> | \$1,189 \$\$ |
| Estimated Cost of New Evaporator Coils In Furnace: <small>(Material + Installation+Labor)</small> | \$23,540 | Estimated Total Cost of New Furnace Unit: <small>(Material + Installation+Labor)</small> | \$26,169 \$\$ |
| Total Estimated Installed Cost For A New Air Conditioning System Setup + New High Efficiency Furnace : <small>(Includes Location Factor)</small> | | \$184,195 \$\$ | |
| Estimated Total Energy Cost Savings From New HVAC System: | \$2,123 \$\$ | Estimated O&M Savings: \$106 | Total Annual Savings: \$2,229 \$\$ |
| Estimated Simple Pay Back Period: | | 82.63 Years | |
| Type of Recommendation | | Capital Cost ECM Recommendation | |

Disclaimer: PREPARED BY EMG, May 2016, INFORMATION CONTAINED IN THIS DOCUMENT IS PRIVILEGED AND CONFIDENTIAL "TRADE SECRET" AND IS THE SOLE PROPERTY OF EMG CORP. THIS MATERIAL MUST BE CONSIDERED PRIVELEDGED AND CONFIDENTIAL BY ALL PARTIES PRIVY.

| UIC | | Upgrade Building Lighting to LED and Install Automatic Lighting Controls | | | | | |
|------------------------------------|----------------|--|------------------------------------|--------------------------|---------------------------------------|--------------------|---------------|
| EAL10 | | Location: Building Interior and Exterior | | | | | |
| | | No. of ECMs | No. of Fixtures | No. of Lamps | KWh Saved | Energy Cost Saving | O & M Savings |
| Upgrade Lighting to LED | | 295 | 496 | 3,551 | 75,851 | \$12,136.22 | \$3,442.14 |
| Existing Technology | Sub-Technology | No. of ECMs | No. of Fixtures | No. of Lamps | KWh Saved | Energy Cost Saving | O & M Savings |
| CFL | CFL - 2 Pin | 0 | 0 | 0 | 0 | \$0 | \$0 |
| CFL | CFL - 4 Pin | 0 | 0 | 0 | 0 | \$0 | \$0 |
| CFL | CFL - Screw-in | 0 | 0 | 0 | 0 | \$0 | \$0 |
| Circuline | T9 | 0 | 0 | 0 | 0 | \$0 | \$0 |
| Incan/H/MR | H | 0 | 0 | 0 | 0 | \$0 | \$0 |
| Incan/H/MR | Incan | 0 | 0 | 0 | 0 | \$0 | \$0 |
| Incan/H/MR | MR | 0 | 0 | 0 | 0 | \$0 | \$0 |
| HID | HPS | 0 | 0 | 0 | 0 | \$0 | \$0 |
| HID | MH | 3 | 8 | 8 | 3,197 | \$511 | \$153 |
| HID | MV | 0 | 0 | 0 | 0 | \$0 | \$0 |
| HID | QL | 0 | 0 | 0 | 0 | \$0 | \$0 |
| Linear Fluorescent | T8 | 0 | 0 | 0 | 0 | \$0 | \$0 |
| Linear Fluorescent | T12 | 0 | 0 | 0 | 0 | \$0 | \$0 |
| Linear Fluorescent | T8 U | 0 | 0 | 0 | 0 | \$0 | \$0 |
| Linear Fluorescent | T12 U | 0 | 0 | 0 | 0 | \$0 | \$0 |
| Linear Fluorescent | T5 | 70 | 488 | 488 | 72,655 | \$11,625 | \$3,290 |
| Linear Fluorescent | T6 | 0 | 0 | 0 | 0 | \$0 | \$0 |
| Linear Fluorescent | T10 | 0 | 0 | 0 | 0 | \$0 | \$0 |
| Proposed Controls | | No. of Controls | | | No. of Controls | | |
| Photo Sensor | | 0 | Ceiling Mounted | | 0 | | |
| Wall Mounted | | 93 | | | | | |
| Initial Investment | | | | Equipment Rentals | | | |
| Material Cost | | \$71,918.38 | Scissor Lift 26' - Interior Spaces | | \$445.00 | | |
| Labor Cost | | \$43,093.52 | Bucket Truck - Exterior Spaces | | \$0.00 | | |
| Local Electric Rate: | | \$0.16 | \$/kWh | | Estimated Annual Energy Savings: | 75,851 | |
| Hourly Labor Rate For Electrician: | | \$82.45 | | | Estimated Annual Energy Cost Savings: | \$12,136 | |
| Budgeted Initial Investment: | | \$115,457 | | | Estimated Annual O&M Cost Savings: | \$3,442 | |
| Estimated Return on Investment: | | 7.41 | Years | | Estimated Annual Cost Savings: | \$15,578 | |
| (Including O&M Savings) | | | | | | | |

Disclaimer: PREPARED BY EMG. AUGUST 2019, INFORMATION CONTAINED IN THIS DOCUMENT IS PRIVILEGED AND CONFIDENTIAL "TRADE SECRET" AND IS THE SOLE PROPERTY OF EMG CORP. THIS MATERIAL MUST BE CONSIDERED PRIVILEGED AND CONFIDENTIAL BY ALL PARTIES PRIVY.

APPENDIX F: Solar PV

| UIC | | Install Fixed Tilt Solar Photovoltaic System | | | | | | | | | | | | | |
|---------------|-------------|--|-------------------------|--------------------------------|---|--|---|--------------------|---------------------------------|---|--|---|---|--|--|
| EAR-2 | | Details: John Still Middle (East Campus) | | | | | | | | | | | | | |
| Select State: | | Northern California | | Electric Rate: | | \$0.16 | | \$/KWH | | Annual Electric Consumption: | | 466,108 | | KWH | |
| Roof No. | Description | Number of Roofs | DC System Size Per Roof | PV System Sizing For All Roofs | Estimated Number of 315 Watt PV Panels: | Total Estimated Annual Electricity Generated/ Roof | Total Estimated Electricity Generated (All Roofs) | Total Cost Savings | Installation Cost: (\$3.5/Watt) | Simple Pay Back Period without Incentives | One Time Potential Utility or State Incentives | One Time Potential Federal Incentives | Annual Potential Incentives and Rebates | | Simple Pay Back Period with All Incentives |
| | | | kW | kW | | kWh | kWh | | | Yrs | | Dept. of Treasury Renewable Grant (30%) | Federal REPI Incentive | Solar Renewable Certificates (SRECS)- (~\$0/MWH) | Years |
| | | | | | | | | | | | | 30% | \$0.02 | \$0 | |
| 1 | Building 1 | 1 | 48 | 48 | 152 | 74,741 | 74,741 | \$11,959 | \$168,000 | 14.0 | \$0 | \$50,400 | \$1,644 | \$0 | 8.5 |
| 2 | Building 2 | 1 | 27 | 27 | 86 | 42,197 | 42,197 | \$6,752 | \$94,850 | 14.0 | \$0 | \$28,455 | \$928 | \$0 | 8.5 |
| 3 | Building 3 | 1 | 31 | 31 | 98 | 47,959 | 47,959 | \$7,673 | \$107,800 | 14.0 | \$0 | \$32,340 | \$1,055 | \$0 | 8.5 |
| 4 | Building 4 | 1 | 7 | 7 | 22 | 10,744 | 10,744 | \$1,719 | \$24,150 | 14.0 | \$0 | \$7,245 | \$236 | \$0 | 8.5 |
| 5 | Building 5 | 1 | 69 | 69 | 220 | 107,907 | 107,907 | \$17,265 | \$242,550 | 14.0 | \$0 | \$72,765 | \$2,374 | \$0 | 8.5 |
| | | 5 | | 182 | 578 | 283,548.0 | 283,548 | \$45,368 | \$637,350 | 14.05 | \$0 | \$191,205 | \$6,238 | \$0 | 8.46 |

| Solar Rooftop Photovoltaic Analysis | |
|-------------------------------------|-------------|
| Total Number of Roofs | 5 |
| Estimated Number of Panels | 578 |
| Estimated KW Rating | 182 KW |
| Potential Annual KWh Produced | 283,548 KWh |
| % of Current Electricity Load | 60.8% |

| Financial Analysis | |
|-------------------------------------|------------|
| Investment Cost | \$637,350 |
| Estimated Energy Cost Savings | \$45,368 |
| Potential Rebates | \$191,205 |
| Potential Annual Incentives | \$6,238 |
| Payback without Incentives | 14.0 years |
| Incentive Payback but without SRECS | 8.5 years |
| Payback with All Incentives | 8.5 years |

Disclaimer: PREPARED BY EMG. JANUARY 2017, INFORMATION CONTAINED IN THIS DOCUMENT IS PRIVILEGED AND CONFIDENTIAL "TRADE SECRET" AND IS THE SOLE PROPERTY OF EMG CORP. THIS MATERIAL MUST BE CONSIDERED PRIVILEGED AND CONFIDENTIAL BY ALL PARTIES PRIVY.