


BX-LF-1 SENSOR DIMENSION

APPROVAL SHEET

CUSTOMER
PO#
SO#
SHIP DATE
QUANTITY
PRODUCT

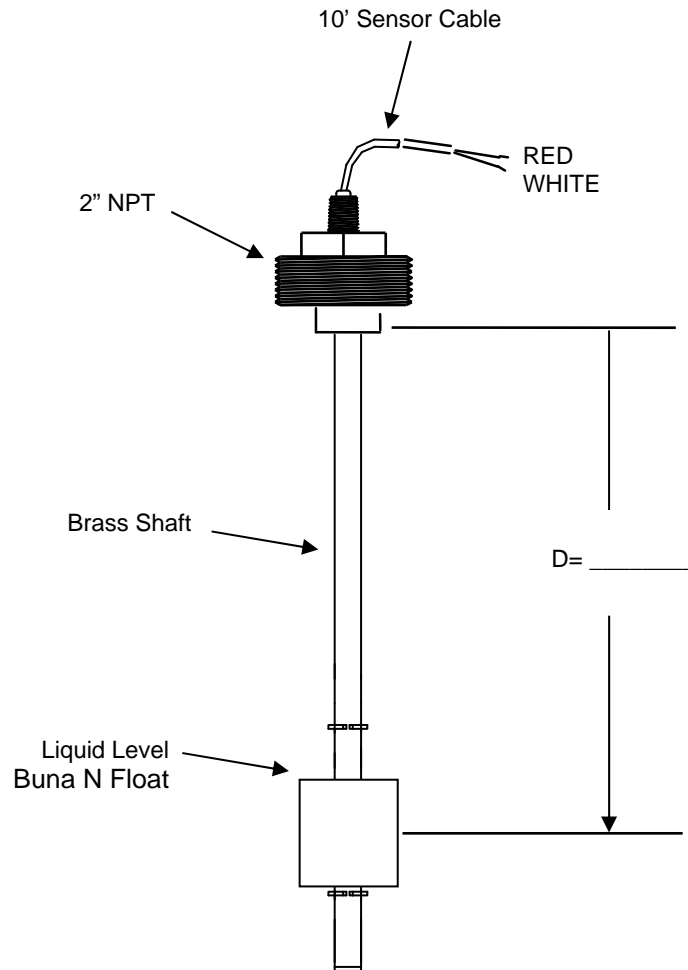

D= dimension For high level in inches*

- * - Be sure to take into account any riser pipes or manway risers.
- Dimensions should be calculated from the top of the tank or riser down to the required alarm level(s)

Name: _____

Company: _____

Signature: _____

Date: _____

***Signature is required to release
product to production***