


LF-4 SENSOR DIMENSION APPROVAL SHEET

| |
|------------------|
| CUSTOMER |
| |
| PO # |
| |
| SO # |
| |
| SHIP DATE |
| |
| QUANTITY |
| |
| PRODUCT |
| |

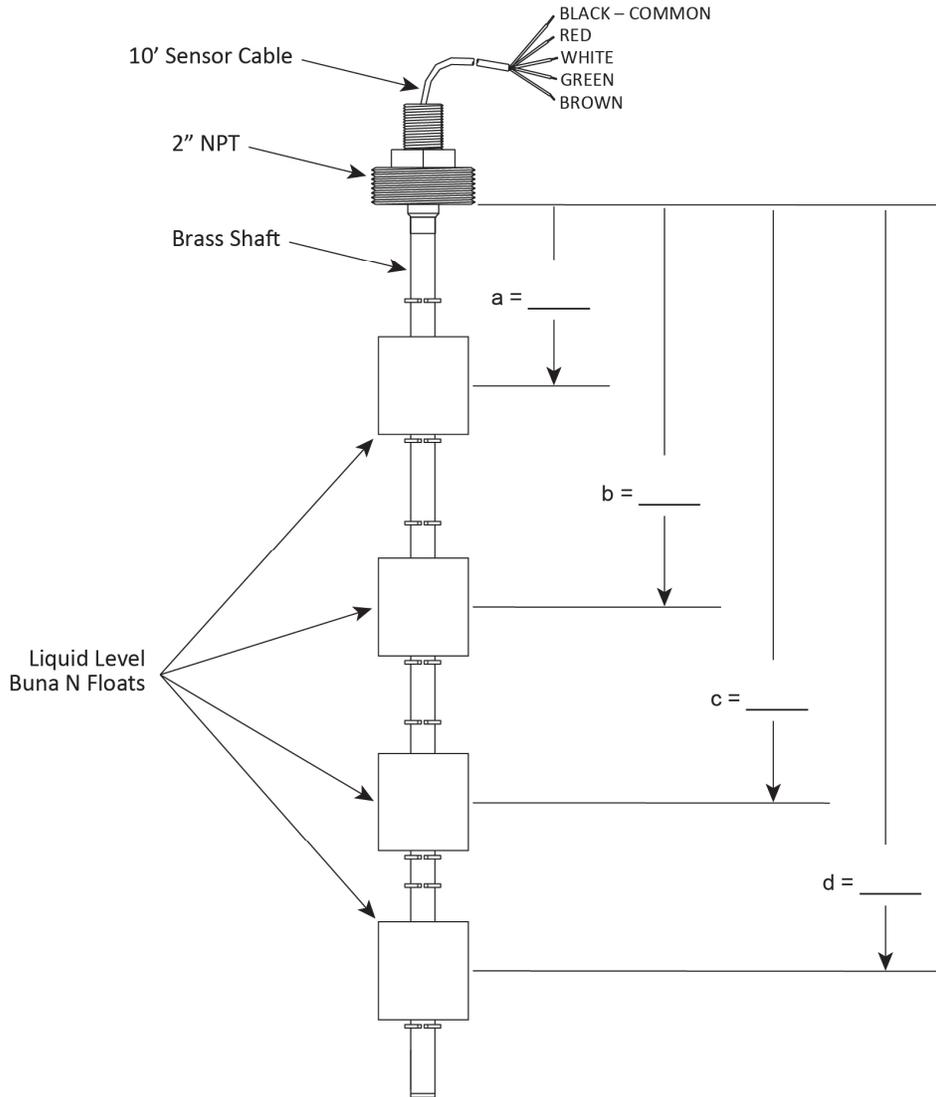

IMPORTANT: Dimensions should be calculated from the top of the tank or riser down to the required alarm level(s) in inches. Be sure to take into account any riser pipes or manway risers.

Name: _____

Company: _____

Signature: _____

Date: _____

Signature is required to release product to production.

***** CUSTOM PARTS ARE NON-CANCELLABLE AND NON-RETURNABLE *****

| WIRING COLOR CODE* | |
|--------------------|--------|
| COMMON | BLACK |
| LEVEL 1 | RED |
| LEVEL 2 | YELLOW |
| LEVEL 3 | BLUE |
| LEVEL 4 | BROWN |
| LEVEL 5 | ORANGE |
| LEVEL 6 | GRAY |

* Colors subject to change. Consult factory or controller connection diagram.