


L-1-D SENSOR DIMENSION APPROVAL SHEET

CUSTOMER
PO #
SO #
SHIP DATE
QUANTITY
PRODUCT

OMNTEC USE ONLY
RES
CABLE LENGTH
CAN

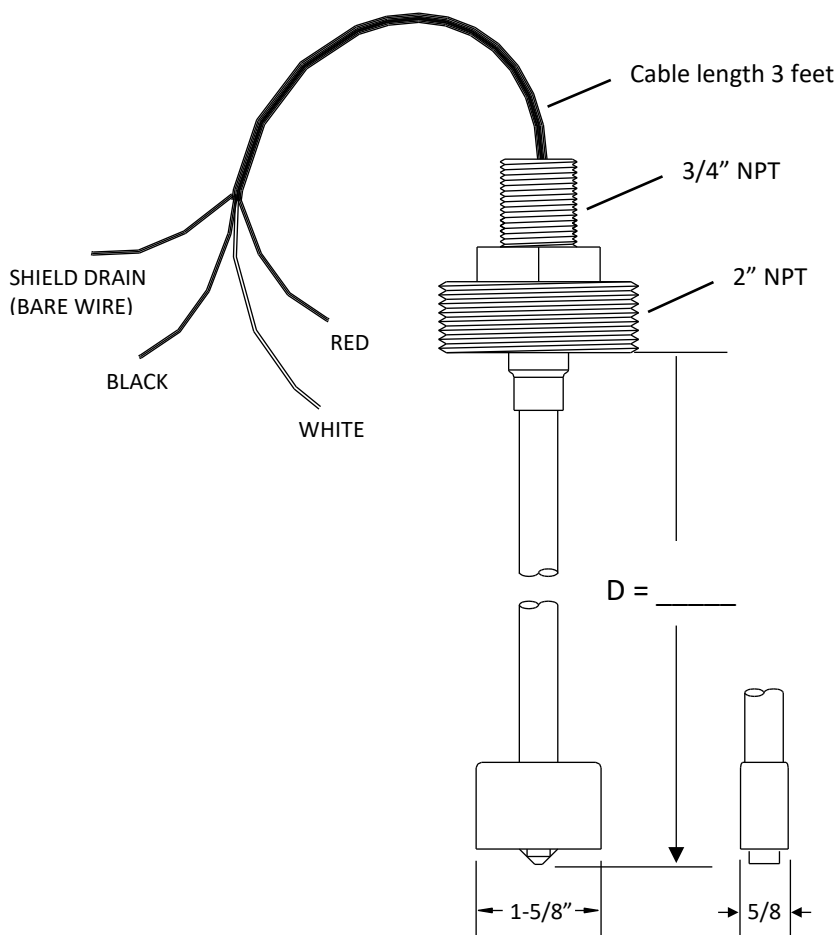

IMPORTANT:

- Minimum dimension from bottom of 2" NPT fitting to "D" dimension is 1.75".
- Dimensions should be calculated from the top of the tank or riser down to the required alarm level(s) in inches.
- Be sure to take into account any riser pipes or manway risers.

Name: _____

Company: _____

Signature: _____

Date: _____

Signature is required to release product to production.

***** CUSTOM PARTS ARE NON-CANCELLABLE AND NON-RETURNABLE *****