


L-2 SENSOR DIMENSION APPROVAL SHEET

CUSTOMER
PO #
SO #
SHIP DATE
QUANTITY
PRODUCT

OMNTEC USE ONLY
RES
CABLE LENGTH
CAN

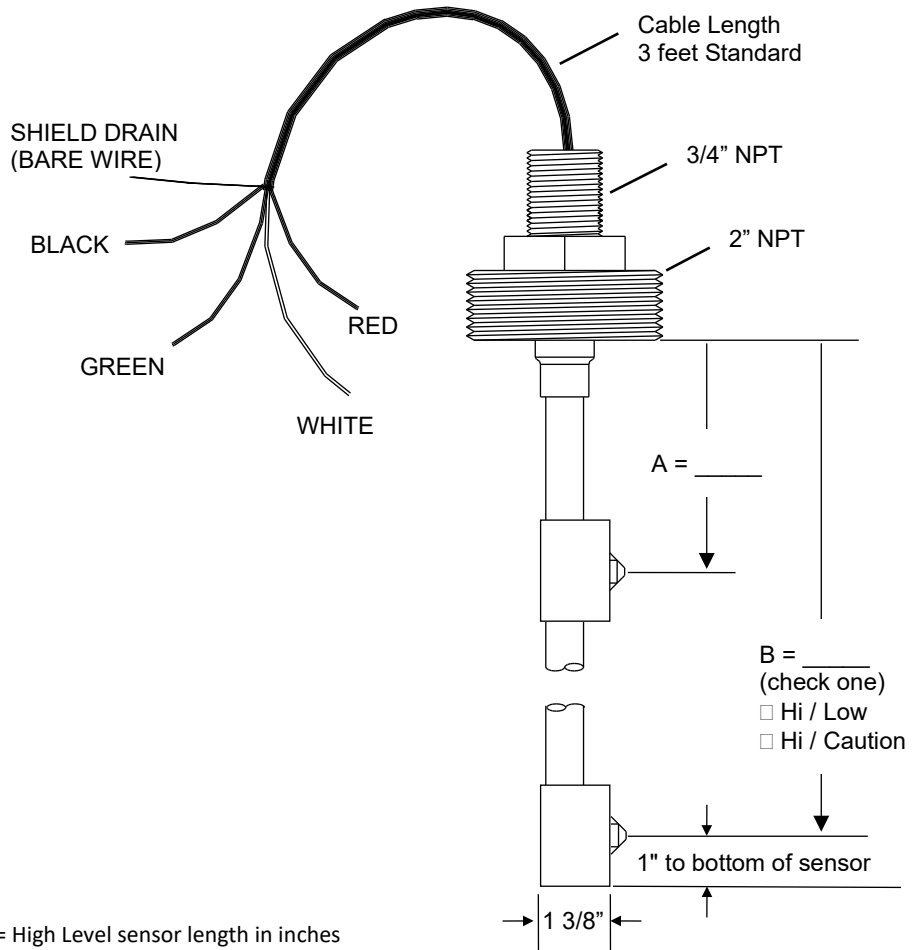

A = High Level sensor length in inches
B = Low Level or Caution Level sensor length in inches

IMPORTANT:

- Minimum dimension from bottom of 2" NPT fitting to "A" dimension is 1.75". Minimum dimension between each set point is 2".
- Dimensions should be calculated from the top of the tank or riser down to the required alarm level(s) in inches.
- Be sure to take into account any riser pipes or manway risers.

Name:	_____
Company:	_____
Signature:	_____
Date:	_____
<i>Signature is required to release product to production.</i>	
*** CUSTOM PARTS ARE NON-CANCELLABLE AND NON-RETURNABLE ***	